

Siemens MProt (MPI/PPI/ISO-TCP) Driver

Filename	MProt.dll
Manufacturer	Siemens, VIPA
Devices	PLCs S7-200, S7-300, and S7-400 Siemens' PLCs series; Vipa's Speed7 and other devices compatible with any protocol of this Driver
Protocol	PPI and MPI (Serial); MPI encapsulated in Ethernet and ISO over TCP (RFC1006 or S7-TCP/IP on Ethernet interface)
Version	4.0.37
Last Update	05/21/2025
Platform	Win32
Dependencies	IOKit v2.00
Superblocks	Yes
Level	0

Introduction

The Siemens multi-protocol (M-Prot) Driver communicates with Siemens S7-200, S7-300, S7-400, and S7-1200 PLCs, as well as VIPA's Speed7 device using Siemens PPI, MPI, ISOTCP, and MPI protocols encapsulated in Ethernet MPI (IBHLink).

The **PPI** protocol must be used only with the S7-200 series, by using an RS232-PPI/MPI converter cable provided by Siemens.

The **MPI** protocol can be used with the S7-300 and S7-400 series using an RS232-PPI/MPI converter cable provided by Siemens, or also with VIPA's Speed7 series on the MPI port using a common RS-232 cable.

The **ISOTCP** protocol, which is also known as **ISO over TCP**, **RFC1006**, or **S7-TCP/IP** on several hardware vendor brochures, can be used with the Siemens S7-300 and S7-400 series by using a CP-3XX, CP-433, or CP-443 Ethernet card. For the S7-1200 model, and also for VIPA's Speed7 series, directly on the CPU's Ethernet port. For the S7-200 model, there is a special variation of the **ISOTCP** protocol for use with the CP-243 interface. This protocol is called **ISOTCP243**.

For PLCs without an Ethernet port, an alternative could be the Ethernet/MPI IBHLink converter provided by IBH Softec or Hilscher, which works on the FDL level. By using this converter, the advantage is a faster nominal speed, up to 187 kbps on an MPI network, while using a serial converter the speed is only 38.4 kbps. Using this converter is an alternative to CP5611 or similar boards.

Another similar alternative is the NETLink PRO Eth converter cable provided by Softing, which converts from **ISOTCP** to **MPI**.

This Driver does not support using Siemens PPI/MPI adapters via USB interface.


This Driver does not support CP5611 or similar interfaces to access an MPI network. Use the S7Functions or Siemens SIMATIC.NET Drivers to communicate with these boards, by using the included OPC Server.

NOTE

M-Prot is a name created by **Eclipse Software** to specify a Driver that supports multiple protocols. There is no relationship whatsoever with device names, protocols, or standards defined by the aforementioned manufacturers.

Driver Settings

This Driver's [P] parameters for configuration are not used. All configurations are performed on the configuration window, shown on the next figure.

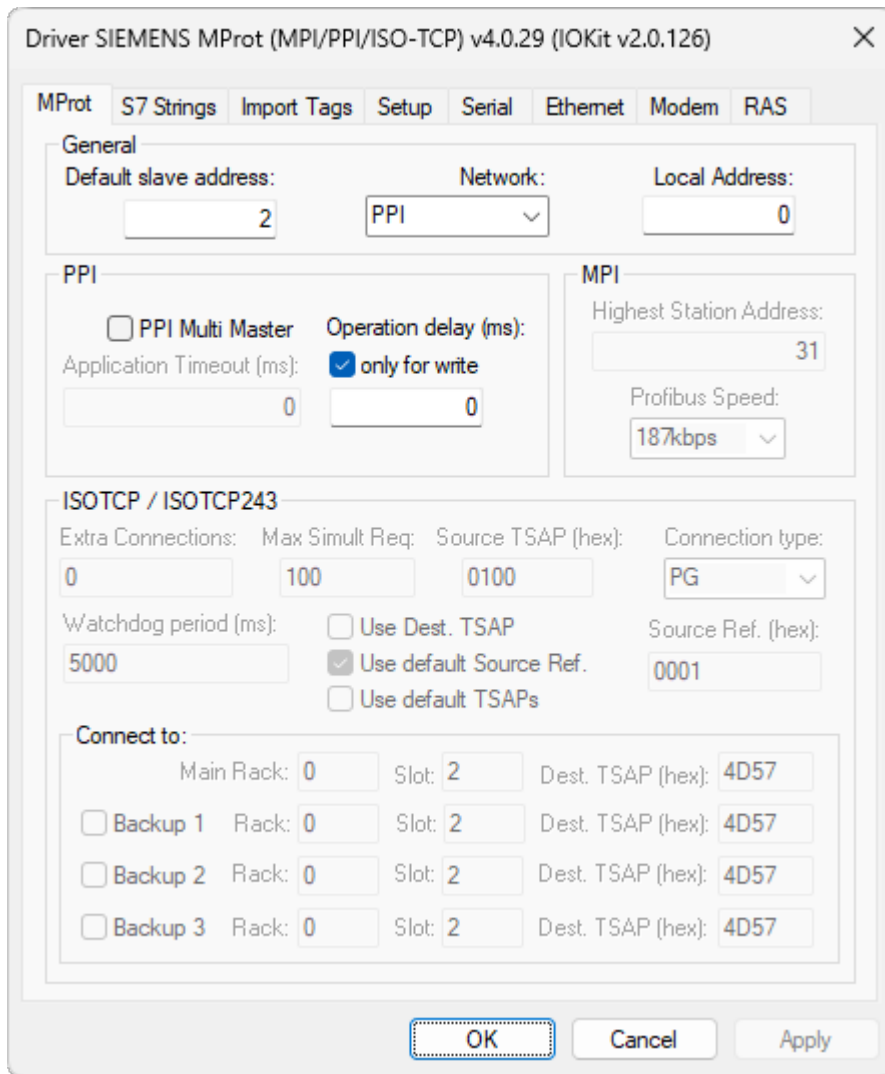

MProt tab

The available options for the **General** group are described on the next table.

Available options on the General group

OPTION	DESCRIPTION
Default Slave Address	This can be used as the default address for any Tag. Leave the <i>N1</i> parameter in 0 (zero) so that it is replaced by the default address
Network	Protocol selection. Available options are PPI , MPI , ISOTCP , ISOTCP for CPU 243 , or MPI for IBHLink converter . The PPI , MPI , or ISOTCP/ISOTCP243 groups on this tab are enabled or disabled according to the selected protocol
Local Address	Driver's address on the network. It can be selected arbitrarily

The available options for the **PPI** group are described on the next table.

PPI group

Available options on the PPI group

OPTION	DESCRIPTION
PPI Multi Master	Informs this Driver that there are other Masters on the network
Application Timeout (ms)	Maximum communication time for each Tag, in milliseconds. Available only when it is a multi-master
Operation delay (ms)	Stop time for an interval between communication operations, in milliseconds. Select the only for write option to apply this interval only for writing operations. For more information, please check the next note

NOTE

The **Operation delay (ms)** option adds a minimum waiting time that must occur between the ending of a reading or writing operation and the beginning of the next one. Use a value different from 0 (zero) on this configuration only if facing communication failures caused by PLC's processing inertia. Writing operations are the most affected ones, because they are usually random, and for these operations there is the **only for write** option. If this option is not selected, the waiting time applies to reading and writing operations. If it is selected, it only applies to writing operations, which is recommended. Notice that adding a waiting time may slow down application's performance.

The available options for the **MPI** group are described on the next table.

MPI group

Available options on the MPI group

OPTION	DESCRIPTION
Highest Station Address	Indicates the greatest available address on the network, so that in PPI and MPI modes this Driver discovers other possible Masters on the network. Only the 15, 31, or 63 values must be added
Profibus Speed	Nominal speed of a Profibus network

The available options for the **ISOTCP / ISOTCP243** group are described on the next table.

ISOTCP / ISOTCP243

Extra Connections: Max Simult Req: Source TSAP (hex): Connection type:

Watchdog period (ms): Use Dest. TSAP Use default Source Ref. Use default TSAPs

Connect to:

Main Rack: Slot: Dest. TSAP (hex):

Backup 1 Rack: Slot: Dest. TSAP (hex):

Backup 2 Rack: Slot: Dest. TSAP (hex):

Backup 3 Rack: Slot: Dest. TSAP (hex):

ISOTCP / ISOTCP243 group

Available options on the ISOTCP / ISOTCP243 group

OPTION	DESCRIPTION
Extra Connections	Number of additional TCP connections that can be created to improve communication performance
Max Simult Req	Maximum number of simultaneous variables on a single request. This configuration can be used to significantly improve communication performance, as long as users use a value greater than 0 (zero) in the Extra Connections option
Source TSAP (hex)	A number formed by a Word in hexadecimal identifying the protocol's local TSAP
Connection type	Connection type. Possible values are PG , OP , or PC . It must be selected according to CPU configuration
Watchdog period (ms)	Interval in milliseconds for Watchdog Tag 's expiration. If this Tag exists and its value does not vary inside this interval, then the Driver performs an IP address switch
Use Dest. TSAP	If this option is selected, enables typing values for Dest. TSAP . If this option is not selected, enables typing values for Rack , Slot and Connection type
Use default TSAPs	If this option is selected, uses default TSAP values and so disables typing configuration values of Source TSAP , Dest. TSAP , Connection Type , Rack , and Slot
Source Ref. (hex)	A number formed by a Word in hexadecimal identifying the protocol's source reference. It is only enabled when the Use default Source Ref option is not selected
Rack	Destination CPU's rack number
Slot	Destination CPU's slot number
Dest. TSAP (hex)	A number formed by a Word in hexadecimal identifying the protocol's destination TSAP
Backup 1 / Backup 2 / Backup 3	Enables typing rack and slot values for the respective backup CPU(s), for use in redundancy systems with values different from the main CPU


For this Driver's communication to work with the Siemens S7-1200 PLC series, users must select the **ISOTCP** option, deselect the **Use default TSAPs** option, configure the **Source TSAP (hex)** property to "0100", and define the **Connection type** option as "PG", **Rack** with 0 (zero), and **Slot** with 1 (one).

NOTES

- When selecting the **ISOTCP** or **ISOTCP243** protocols, all Tags in the Driver object must have the *N1* or *B1* parameter in 0 (zero) and the **Default Slave Address** parameter also in 0 (zero).
- The **Source Ref** and **Source TSAP** parameters must be considered only in very specific cases. Due to successful executions in a wide range of topologies, it is strongly recommended to always keep the **Use default Source Ref** selected and the **Source TSAP** value always as "0100".
- When the **Use Default TSAPs** option is selected together with the **ISOTCP** protocol, the **Source TSAP** value is "0100" and the **Dest. TSAP** value is "0202".
- TSAP stands for *Transport Service Access Point*, which is a terminology used by the ISO protocol.
- When using PC - PPI/MPI serial adapters, it is very common the need to configure the handshaking on the **Serial** tab of Driver's configuration window. Only the **RTS** control must be configured to **ON**. If there is any unsuccessful communication during this Driver's initial tests, it is advisable to try that change, **RTS Control** configured to **ON**, and execute the test again.

String Configuration Parameters

This tab is useful only if users must declare **Strings** or **WStrings** with a defined maximum length.

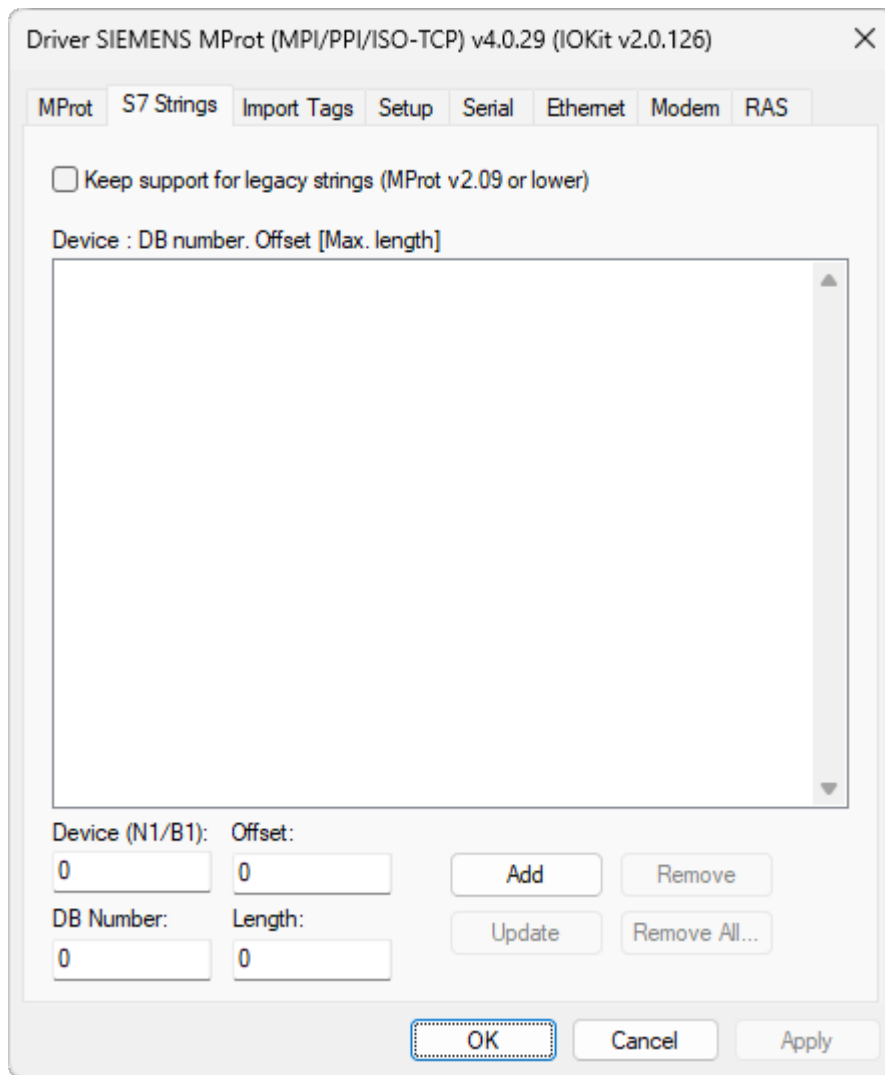

S7 Strings tab

The available options on the **S7 Strings** tab are described on the next table.

Available options on the S7 Strings tab

OPTION	DESCRIPTION
Keep support for legacy strings (MProt v2.09 or lower)	Keeps support for old Strings , prior to version 2.10. By selecting this option, the old String format implemented on prior versions is kept, avoiding problems when updating this Driver's version. It is advisable to select this option only when migrating a project whose Driver's version is 2.09 or earlier. If the project uses Strings after performing a version update, String -type Tags return reading errors from the PLC. The legacy String format contains a 32-byte reserved space starting from the configured offset. When working with a new project, leave this option deselected

List of Strings' Maximum Lengths

This tab also displays a selectable list with declared **Strings** with pre-determined lengths. This list appears empty if there are no configured **Strings**. These **Strings** can be declared in the PLC memory in the following ways:

- Without specifying a maximum length on declaration. Example:

```
STRING var;
```

The **String** is allocated automatically with PLC's standard maximum length.

- By specifying a maximum length on declaration. Example:

```
STRING var[50];
```

On the previous example, the **String** is allocated with a maximum length of "50". Due to that second form, this list of **String** lengths is so important.

To determine the length of a new declared **String**, users must fill in all fields correctly, as described on the next table.

Available options to configure Strings' maximum length

FIELD	DESCRIPTION
Device	PLC address. Fill it in with the same value of Tag's <i>N1/B1</i> parameter. For more information, please check topic Configuration by Numerical Parameters (N/B)
DB Number	Type the value of the DB number where the String is located
Offset	Type the value of the DB offset where the String is located
Length	Type the maximum length value of the String , as declared in the PLC programming

If there is already a **String** declared on the list with the same value for **Device**, **DB Number**, and **Offset**, that one is automatically selected on the table and its values are loaded to all edit fields. The following options help users when editing **String** data on the list:

- **Add:** Adds new parameters
- **Update:** Changes parameters already listed
- **Remove:** Completely removes a row of parameters


Click **OK** to confirm all configurations listed and close this window. Click **Remove All** to remove all data from this list.

NOTE

When declaring Tags with Symbolic Addressing parameters, there is no need to fill in this list with **String** declarations. Their length can be specified on the symbol parameter available in the Tag.

Importing Tags

The **Import Tags** tab brings some features for Tag importing from a **TIA Portal** (*Totally Integrated Automation Portal*) automation project.

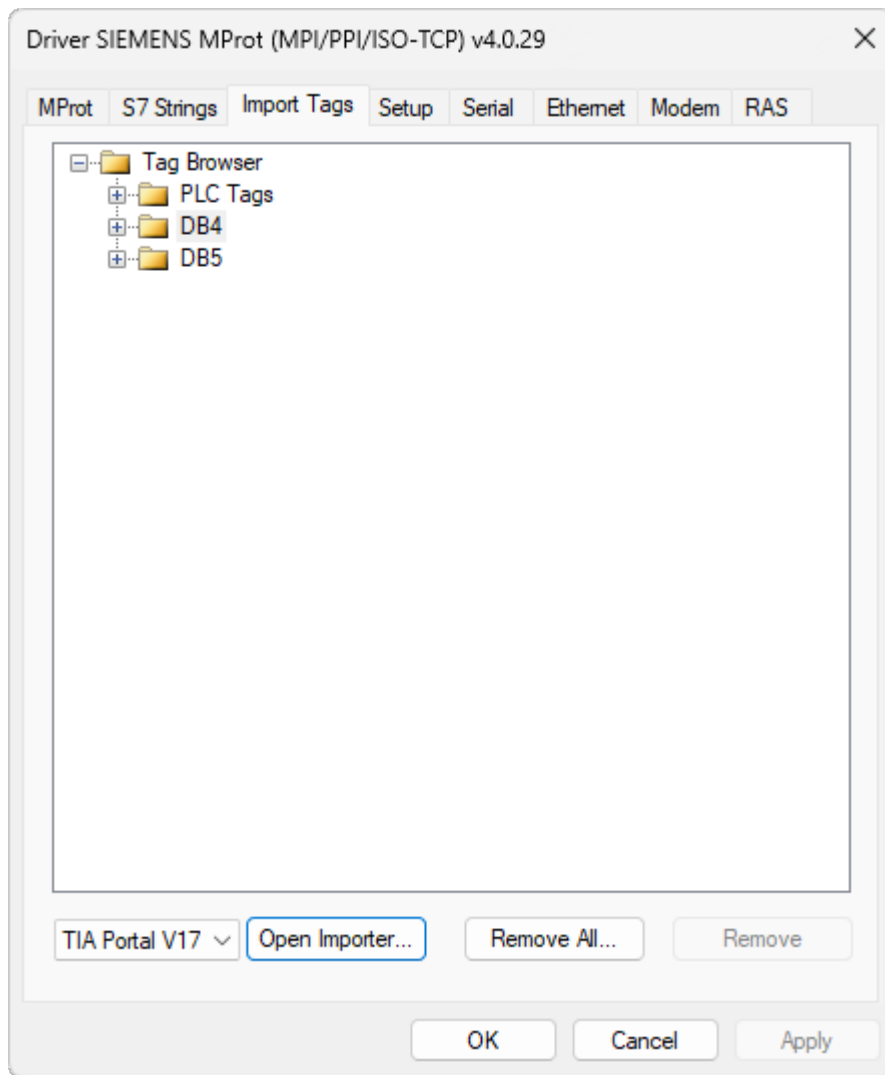

Import Tags tab

The **Import Tags** tab shows a tree view structure of Tags already imported and saved to this Driver's project. When users include a new Driver in a project, the initial state is an empty structure, only with a **Tag Browser** folder. Users can include imported Tags selecting the TIA Portal version and using the **Open Importer** option described on topic **MProt TIA Portal Importer**.

If there are Tags already imported to this tree view structure, users can use the **Remove** option to remove the selected Tag and the **Remove All** option to remove all imported Tags. Click **OK** to save all Tags and display them on **Tag Browser**.

NOTES

- Only the **LReal** data type is not supported when importing Tags. If there are variables with this data type in a project, they are ignored by the importer, which proceeds with the import process of the variables with other data types.
- Blocks with **ArrayDB** and **InstanceDB** data types are not supported when importing Tags.


MProt TIA Portal Importer

The **MProt TIA Portal Importer** is an executable file, distributed along with Siemens MProt (MPI/PPI/ISO-TCP) Driver, intended to import Tags from an automation project created using TIA Portal, from Siemens. To ensure its proper functioning, the executable must match the following requirements:

- Siemens TIA Portal versions 16, 17, 18, 19, or 20 installed
- Microsoft .NET Framework version **4.8** or later installed


- Folders **TIAImporterV16**, **TIAImporterV17**, **TIAImporterV18**, **TIAImporterV19**, and **TIAImporterV20**, provided with this Driver, must be located in the same folder as this Driver
- The MProtTiaPortallImporter.exe executable files and the Siemens.Engineering.dll files, provided with this Driver, must be located within the folders mentioned earlier
- The user account using the Importer must be added to the **Siemens TIA Openness** local group of users, located on Windows Administrative Tools

MProt TIA Portal Importer is started by clicking **Open Importer** on the **Import Tags** tab of this Driver's configuration window. The window on the next figure is then displayed.

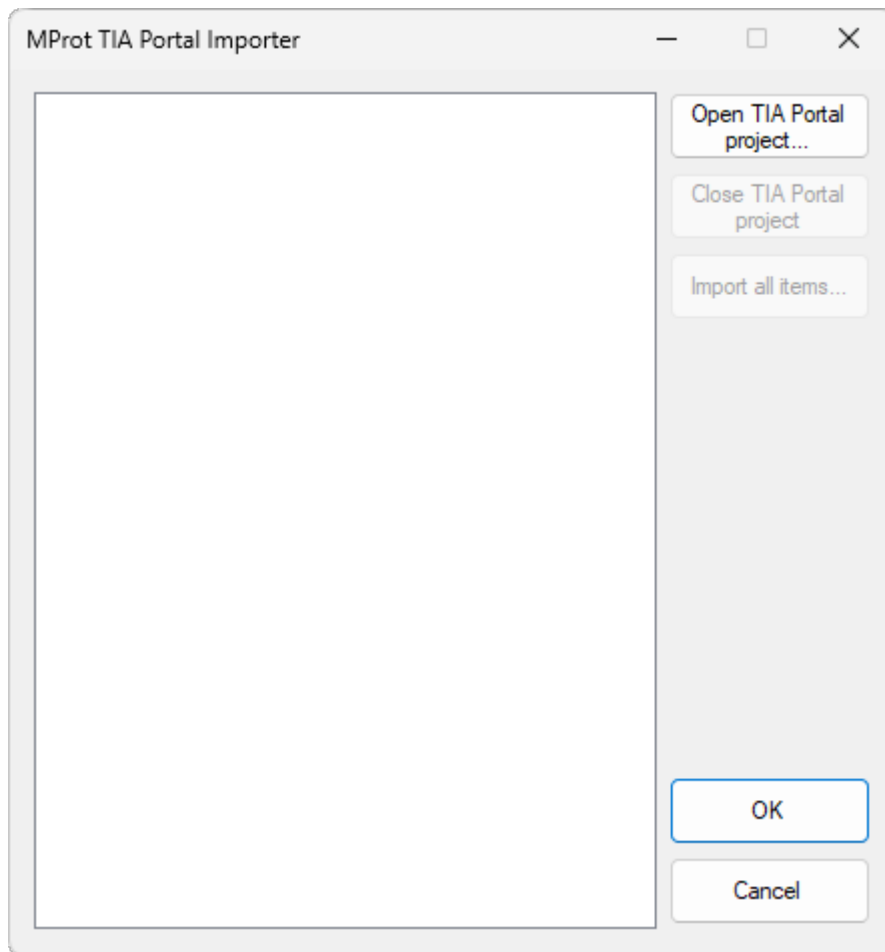


MProt TIA Portal Importer

Click **Open TIA Portal project** to select a TIA Portal project file and click **OK** to open an instance of TIA Portal in background. If TIA Portal firewall does not find **MProt TIA Portal Importer** on the authorization list, a dialog box is opened with options **Yes** to allow access, **Yes to all** to allow access and save the access authorization on the authorization list, and **No** to refuse access, according to the next figure.

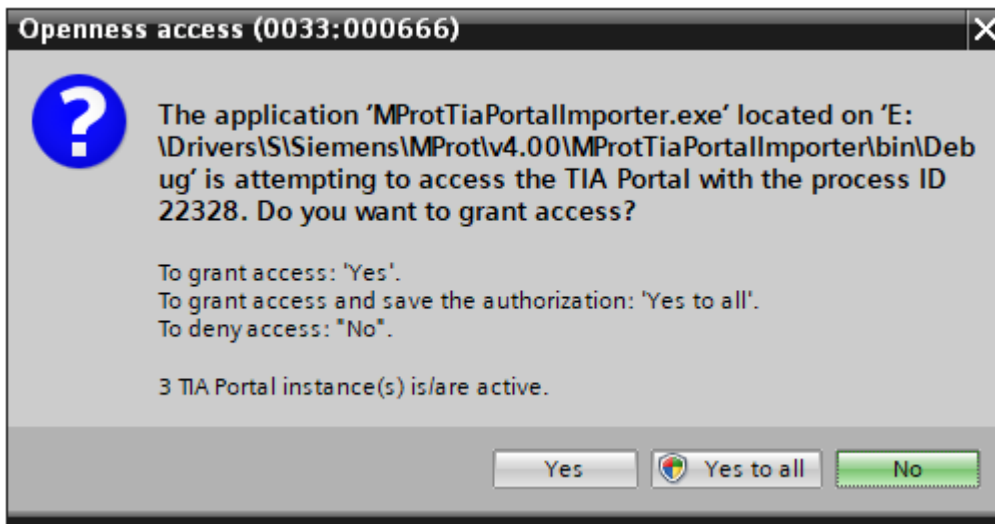

Access configuration

After authorizing **MProt TIA Portal Importer**, it is opened displaying the project's tree structure with the items to import.

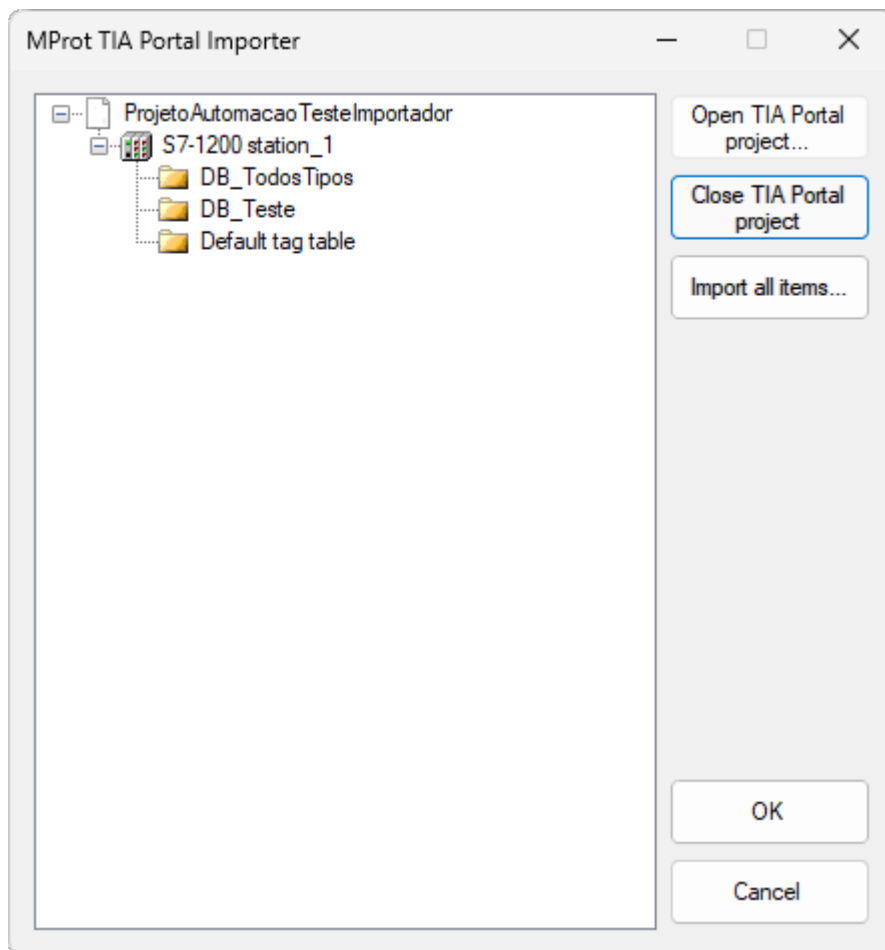

Items to import

To import all Tags from a project, click **Import all items**. After finishing the import process, click **OK** to confirm it and close the Importer. When closing the Importer, the Tags are automatically imported into this Driver's configuration window, where they can be saved. For more information, please check topic **Importing Tags**. The **Close TIA Portal project** option allows closing the project and the **Cancel** option closes the Importer without performing an import process.


Tag Reference

This section contains information about the configuration of Tags by **Symbolic Addressing** and by **Standard Addressing** (*N/B* parameters). It also contains references to **Interface Tags on Extra ISOTCP Connections**.

Using Tag Browser

Elipse E3 starting with version **2.0**, **Elipse Power**, and **Elipse Water** have a tool called **Tag Browser**, which allows a Driver to help users on creating and configuring Tags.

Tag Browser aims to automate Tag configuration by automatically filling the **Item** field and the proper size of Elements, if it is a Block Tag.

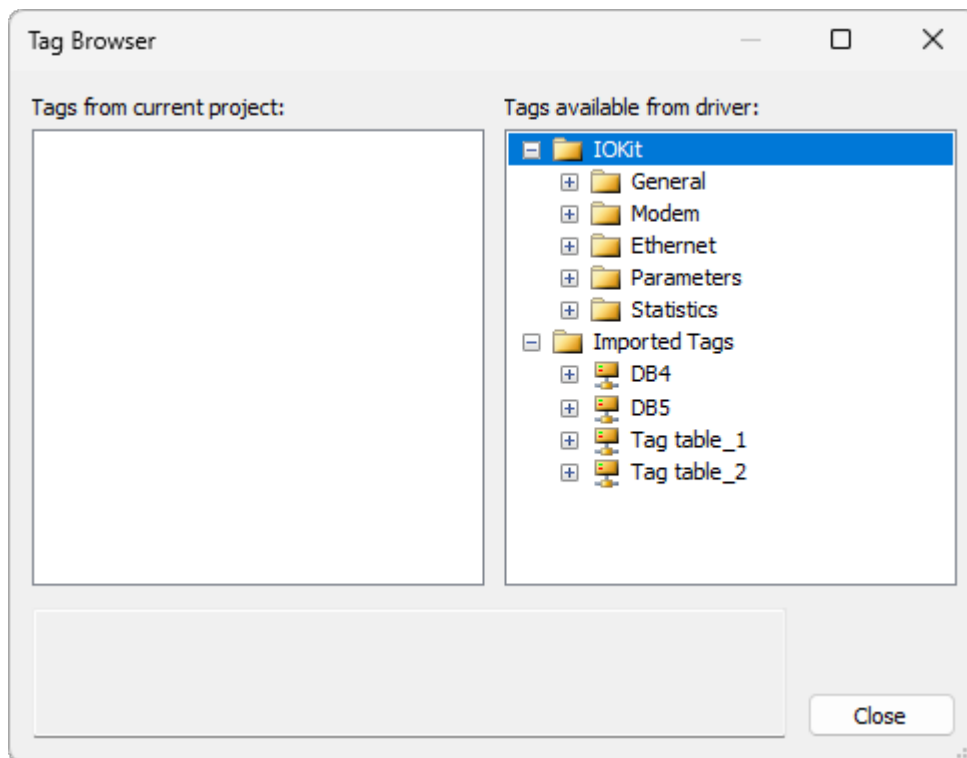

Tag Browser

The **Tags from current project** list displays Tags and folders already in the current project. The **Tags available from driver** list displays a tree with Tags provided by this Driver. To create a new Tag in an application, drag one of the Driver-defined Tags to a folder on the current directory. Siemens MProt (MPI/PPI/ISO-TCP) Driver provides the following nodes on this tree:

- The **IOKit** node displays Tags available on **IOKit** library, grouped into the following categories:
 - **General:** Tags for general use
 - **Modem:** Tags for manipulating communication via modem
 - **Ethernet:** Tags for manipulating communication via Ethernet network
 - **Parameters:** Tags for configuring **IOKit** library parameters
- The **Imported Tags** node shows all Tags imported and saved on the **Import Tags** tab. This node only appears if there are actually imported Tags. In this case, this node contains a folder for each separate group of imported Tags. If there is a Data Block (DB), the Tags referring to the variables in this DB are grouped into one folder in reference to this DB. The other Tags are grouped into folders referring to the table to which they belong. Each Tag is created with the **Device** field with a default value of 0 (zero)

Configuration by Syntactical Parameters

Use the following syntax for each field in **Elipse E3**, **Elipse Power**, or **Elipse Water**:

- **Device:** Insert the device's address on the network. If it is equal to 0 (zero) and the selected protocol is different from **ISOTCP** or **ISOTCP243**, then it is replaced by the **Default Slave Address**. If the selected protocol is **ISOTCP** or **ISOTCP243**, this value must be left as 0 (zero). The **Device** field may also be left blank, as long as it is inserted in the **Item** field before the colon symbol
- **Item:** This field must obey one of the defined syntaxes described next

Use the following general syntax if area is not equal to **DB**. Values inside brackets are optional:

```
<[Device:]><Area><[Type]><Address>[.Bit]
```

Where:

- **Device:** PLC address as exposed in the **Device** item, if it was not informed in that field
- **Area:** Data area inside the PLC. The following options can be used:
 - **S**
 - **SM**
 - **AI** (*Analog Input*)
 - **AQ** (*Analog Output*)
 - **C** (*Counter*)
 - **T** (*Timer*)
 - **I** (*Digital Input*)
 - **Q** (*Digital Output*)
 - **M** (*Memory*)
 - **HC** (*High Speed Counter*)
- **Type:** Data type to read. The next table shows all possible symbols for these data types

Available options for data types

DATA TYPE	MEANING
X	Used to read or write a bit from a byte
B	Byte
W	Word
D	DWord
I	Int
LI	DInt
F	Float
S	String
WS	WString

DATA TYPE	MEANING
S5T	S5Time
RB	Byte (LSB First)
RW	Word (LSB First)
RD	DWord (LSB First)
RI	Int (LSB First)
RLI	DInt (LSB First)
SW	Word (least significant byte first)
SD	DWord (least significant byte first)
SI	Int (least significant byte first)
SLI	DInt (least significant byte first)

NOTES

- **LSB First** data types mean the bit order is least significant bit comes first and its interpretation is as the reverse of the other data types.
- Data types with the **least significant byte first** mean the byte order is least significant byte comes first and most significant byte comes last.

- **Address:** Numerical address to read
- **Bit:** Optional informing the bit from a word to read or write, between 0 (zero) and 31

Example:

```
(PLC 4, bit 1 from memory at address 10)
Device: Blank - Item 4:M10.1
```

If the data area is equal to **DB**, also known as **V**, use the following syntax. Values inside brackets are optional:

```
<[Device:]>DB<DBNumber>:<Type><Address><[.Bit]>
```

- **Device:** Refers to the same optional item of the general syntax
- **DBNumber:** Fill it in with the **DB** number. If the memory contains a single or unspecified **DB** block, fill it in with value 1 (one)
- **Address:** Numerical address (offset) to read
- **Bit:** Optional value informing the bit of a type to read or write, between 0 (zero) and 31

Available options for data types on DB data areas

DATA TYPE	MEANING
DBX	Used to read or write a bit from a byte in a DB
DBB	Used to read or write a byte in a DB
DBW or DW	Used to read or write a Word in a DB

DATA TYPE	MEANING
DBD or DD	Used to read or write a Double Word in a DB
DBI or DI	Used to read or write a Int in a DB
DBLI or DLI	Used to read or write a DInt in a DB
DBF or DF	Used to read or write a Floating Point (32-bit real) in a DB
DBS or DS	Used to access a String in a DB
DBWS or DWS	Used to access a WString in a DB
DBS5T	Used to access an S5Time -type timer in a DB
DBB	Used to read or write a byte in a DB (LSB First)
DBW or DW	Used to read or write a Word in a DB (LSB First)
DBD or DD	Used to read or write a Double Word in a DB (LSB First)
DBI or DI	Used to read or write a Int in a DB (LSB First)
DBLI or DLI	Used to read or write a DInt in a DB (LSB First)
SDBW or SDW	Used to read or write a Word in a DB (least significant byte first)
SDBD or SDD	Used to read or write a Double Word in a DB (least significant byte first)
SDBI or SDI	Used to read or write a Int in a DB (least significant byte first)
SDBLI ou SDLI	Used to read or write a DInt in a DB (least significant byte first)

Examples:

```
(PLC 2, Word starting at address 20 of DB1)
Device: 2 - Item: DB1:DW20
(Same as the previous one, but Device was informed in the Item field)
Device: Empty - Item: 2:DB1:DW20
(PLC 7, DB 5, bit 2 from byte 7)
Device: Empty - Item: 7:DB5:DBX7.2
```

The syntax for **String** or **WString** data types in the **DB** data area is the following:

```
<[Device:]>DB<DBNumber>:DBS<Address><<[Maximum length]>
```

Where:

- **Device, DBNumber, and Address:** Refer to the same items of the general syntax
- **Maximum length:** Optional informing the maximum length declared on the **String** or **WString**. If it is not informed, then it considers the maximum default length of the **String** (254 characters) or of the **WString** (16382 characters)

Examples of syntax for **Strings**:

(PLC 2, String starting at address 16 of DB17, using PLC's maximum default length)
 Device: 2 - Item: DB17:DBS16
 (same as the previous one, but Device was informed in the Item field and with a maximum allocated length of 25 characters)
 Device: Empty - Item: 2:DB17:DBS16[25]
 (PLC 4, String starting at address 100 of DB10, with a maximum allocated length of 50 characters)
 Device: Empty - Item 4:DB10:DS100[50]

Configuration by Numerical Parameters (N/B)

Use the default syntax described on the next table for all Tags and Blocks.

Default syntax for Tags and Blocks

PARAMETER	DESCRIPTION
N1/B1	PLC address. If it is equal to 0 (zero) and the selected protocol is different from ISOTCP or ISOTCP243 , then it is replaced by the Default Slave Address . If the selected protocol is ISOTCP or ISOTCP243 , this value must be left as 0 (zero)
N2/B2	Data type and Data area. For more information, please check the next tables. This value must be composed by the data type multiplied by 100 plus the data area (its formula is $N2/B2 = DataType \times 100 + Area$)
N3/B3	If the selected area is V (DB) , fill it in with the number of the DB block. Otherwise, leave it in 0 (zero). If the memory contains a single or unspecified DB block, fill it in with the value 1 (one)
N4/B4	DB block's address in the data area or offset. To use data types that require more than one byte, use addresses that are multiples of two for two-byte types (signed or unsigned 16-bit) and multiples of four for four-byte types (signed or unsigned 32-bit and 32-bit floating point)

Available options for data types

DATA TYPE	MEANING
0	Data area's default
1	BOOL (Boolean)
2	BYTE (unsigned 8-bit)
3	WORD (unsigned 16-bit)
4	INT (signed 16-bit)
5	DWORD (unsigned 32-bit)
6	DINT (signed 32-bit)
7	REAL (32-bit floating point, IEEE 754)
8	STRING
12	S5TIME (time in seconds, 32-bit floating point, IEEE 754, please check the next note)

DATA TYPE	MEANING
13	WSTRING
32	BYTE (unsigned 8-bit, LSB First)
33	WORD (unsigned 16-bit, LSB First)
34	INT (signed 16-bit, LSB First)
35	DWORD (unsigned 32-bit, LSB First)
36	DINT (signed 32-bit, LSB First)
43	WORD (unsigned 16-bit, least significant byte first)
44	INT (signed 16-bit, least significant byte first)
45	DWORD (unsigned 32-bit, least significant byte first)
46	DINT (signed 32-bit, least significant byte first)

Available options for data areas

DATA AREA	MEANING
0	S
1	SM
2	AI (Analog Input)
3	AQ (Analog Output)
4	C (Counter)
5	T (Timer)
6	I (Digital Input)
7	Q (Digital Output)
8	M (Memory)
9	V (DB)
10	HC (High Speed Counter)

NOTES

- **LSB First** data types consider the bit order is the least significant bit comes first and its interpretation is as the reverse of the other data types.
- Data types with the **least significant byte first** consider the byte order is the least significant byte comes first and the most significant byte comes last.
- For **S5Time** data types, the value to be filled in is always in seconds, as a 32-bit floating point. The range of values different from zero is between 0.01 and 9990.0 seconds. The time base is filled in or interpreted automatically.
- In the **PPI** protocol there is a limitation in the I/O Block for data in bytes. When reading, the maximum allowed is 224 bytes, and when writing it is 218 bytes. This means, respectively, that for **Word** data types (16 bits), a Block cannot have more than 112 and 109 Elements. For **DWord** data types (32 bits), a Block cannot have more than 56 and 54 Elements, and so on.
- If **Rack** and **Slot** definitions are unknown for Tag addressing in the **ISOTCP** protocol, please check article *KB-39019: Rack and Slot settings* on **Eclipse Knowledgebase**.

Interface Tags on Extra ISOTCP Connections

By opting to use extra ISOTCP connections with the **Extra Connections** parameter on the **Driver's configuration window**, these connections can be controlled and monitored by Interface-specific Tags **Physical Layer Status**, **IPSelect**, and **IPSwitch**.

NOTE

These Tags cannot be used when the **Extra Connections** parameter is equal to 0 (zero). In this case, use the corresponding **IOMKit** Tags, with the same name, whose usage can be checked on topic **Documentation of I/O Interfaces**.

Physical Layer Status (MProt)

Read-Only

Configuration by numerical parameters

PARAMETER	VALUE
N1	-2 (minus two)
N2	0 (zero)
N3	0 (zero)
N4	2 (two)

Configuration by syntactical parameters

PARAMETER	VALUE
Item	MProt.IO.PhysicalLayerStatus

This Tag indicates the status of the connection on the physical layer. Possible values are **0**: Physical layer disconnected or **1**: Physical layer connected.

IPSelect (MProt)

Reading and Writing

Configuration by numerical parameters

PARAMETER	VALUE
N1	-2 (minus two)
N2	0 (zero)
N3	4 (four)
N4	0 (zero)

Configuration by syntactical parameters

PARAMETER	VALUE
Item	MProt.IO.Ethernet.IPSelect

Indicates the active IP address. Possible values are **0**: The main IP address is selected or active or **1**: The alternative or backup IP address is selected or active.

If the Ethernet interface is connected, this Tag indicates which one of the two configured IP addresses is in use. If the interface is disconnected, this Tag indicates which IP address is used first in the next attempt to connect.

During the connection process, if the active IP address is not available, then **IOkit** tries to connect to the other IP address. If the connection to the alternative IP address succeeds, then this IP address is set as the active one, that is, an automatic switchover.

To force a manual switchover, write 1 (one) or 0 (zero) to this Tag. This forces a reconnection with the specified IP address (**0**: Main IP address and **1**: Backup IP address) if this Driver is currently connected. If this Driver is disconnected, that configures the active IP address for the next attempt to connect.

IPSwitch (MProt)

Write-Only

Configuration by numerical parameters

PARAMETER	VALUE
N1	-2 (minus two)
N2	0 (zero)
N3	4 (four)
N4	1 (one)

Configuration by syntactical parameters

PARAMETER	VALUE
Item	MProt.IO.Ethernet.IPSwitch

Writing any value to this Tag forces a manual switchover. If the main IP address is active, then the backup IP address is activated, and vice versa. This forces a reconnection to the specified IP address if this Driver is currently connected. If this Driver is disconnected, that configures the active IP address for the next attempt to connect.

Watchdog Tag

This feature is useful only for redundancy architectures that rely on a variable in the CLP to be elected to indicate the time to switch the destination IP address. In the vast majority of cases, this type of Tag is not needed. If this is the case to apply to a project, this Tag must be a **Boolean** variable (**BIT**) that must vary its value before the configured time expires, and logically must be read with a fairly scan time lower than the expiration time, configured in the **Watchdog period (ms)** option on the **ISOTCP / ISOTCP243** group of the **MProt** tab on the configuration window. Whenever this variable does

not vary by that period, the IP address switch is then executed. To configure a Tag as a **Watchdog**, add a **"/watchdog"** **String** at the end of the syntax parameter **Item**, such as "DB2:DBX0.0/watchdog".

ReadOnce Tag

In communication architectures using the **ISOTCP** protocol with a huge number of I/O Tags, over a thousand Tags, it can be interesting that a portion of these Tags be read only once when entering the **In Advise** status (please check the next **note**), as opposed to normal, which are read repeatedly with each scanning cycle. For performance improvement, **ReadOnce** Tags are removed from the block of reading Tags, decreasing the volume of information in future readings.

The **ReadOnce** Tag is only read again when leaving the **In Advise** status and then returning, or when some disconnection or communication failure occurs.

To configure a Tag as **ReadOnce**, add a **"/readonce"** **String** at the end of the syntax parameter **Item**, such as "DB2:DB0/readonce".

This feature is used exclusively for **ISOTCP** configuration with **Extra Connections** equal to or greater than 1 (one).

NOTE

The **In Advise** status of a Tag is defined by this Tag remaining in constant update, at time intervals defined by its **Scan** property, that is, scan periods.

The way to change a Tag status to **In Advise** is by configuring its **AllowRead** property to True and by one of the next conditions:

- A Tag's **AdviseType** property is equal to 0 (zero), that is, it is equal to **AlwaysInAdvise**
- A Tag's **AdviseType** property is equal to 1 (one), that is, it is equal to **AdviseWhenLinked**, and it is linked to an active object on an open Screen

If one of these conditions is not available, the I/O Tag does not have its status set to **In Advise**, that is, it is not read.

SOE Collecting

This section contains specific information about SOE's event collecting.

Preparing for SOE Collecting

Before using SOE Collecting Tags, users must prepare the PLC by creating a **DB** Table (**V** area) and developing a programmable logic compatible with all SOE collecting procedures developed for this Driver.

Table of SOE Events

This table aims to configure the size of the event buffer and manage their input and output in a circular buffer routine. This table is constantly updated by both the PLC and the Siemens MProt (MPI/PPI/ISO-TCP) Driver.

The Table of SOE Events must contain registers on control and storage of events, based on the data structure described on the next table.

Data structure

ADDRESS	DESCRIPTION	DATA TYPE
0.0		STRUCT

ADDRESS	DESCRIPTION	DATA TYPE
+0.0	Table status	WORD (unsigned 16-bit)
+2.0	Recording pointer	WORD (unsigned 16-bit)
+4.0	Acquisition status	WORD (unsigned 16-bit)
+6.0	Maximum limit of items on the circular buffer	WORD (unsigned 16-bit)
+8.0	Circular buffer	ARRAY[1..n] (limit of user-defined items)
+0.0		STRUCT
+0.0	TIMESTAMP_LOLO (year)	WORD (unsigned 16-bit)
+2.0	TIMESTAMP_LOHI (day and month)	WORD (unsigned 16-bit)
+4.0	TIMESTAMP_HILO (hour and minute)	WORD (unsigned 16-bit)
+6.0	TIMESTAMP_HIHI (second and millisecond)	WORD (unsigned 16-bit)
+8.0	Value of event type 1 (one)	Event's data type (user-defined)
+n.0	Value of event type 2 (two)	Repeats the same data type
+n.0	Value of event type 3 (three)	Repeats the same data type
+n.0	Value of event type n	Repeats the same data type
=n.0		END_STRUCT
=n.0		END_STRUCT

Description of Event Control Registers

- **Table Status:** It must be kept exclusively by the PLC, indicating the number of events available for reading in the circular buffer. It must be updated by the PLC whenever new events are added to the circular buffer, or after completing the collecting of events by the application, which can be detected when **Acquisition Status** changes
- **Recording Pointer:** It must be kept exclusively by the PLC, indicating the index, starting at 0 (zero), of the position where the next event must be inserted. The index must be incremented by the PLC whenever a new event is inserted in the circular buffer, then returning to index 0 (zero) after reaching the maximum limit of the circular buffer
- **Acquisition Status:** It must be kept by the PLC and by the Siemens MProt (MPI/PPI/ISO-TCP) Driver, indicating the number of records already read at every transaction. After each collecting, the Siemens MProt (MPI/PPI/ISO-TCP) Driver writes to this register the number of events that it could read. When detecting this change, the PLC must immediately subtract this value written by the Siemens MProt (MPI/PPI/ISO-TCP) Driver from the **Table Status** and then reset the **Acquisition Status**
- **Maximum Limit of Items of the Circular Buffer:** A constant value that specifies the maximum limit of events to store in the circular buffer before the pointer moves back to index 0 (zero). It must contain exactly the limit value of the Array resized for events of the circular buffer

Description of Event Storage Registers

- **TIMESTAMP:** Time when the event occurred
- **Event Value:** Value of the occurred event, which can be composed by one or *n* values, all with the same data type, in which they are grouped together for the same **TIMESTAMP** generated when an event occurs

TIMESTAMP format

A **TIMESTAMP** is represented by four **Words**, according to the data structure described on the next table.

Data structure

WORD	CONTENT	RANGE
0	Year	Between 0 (zero) and 65535
1	Day and month	ddddddmmmmmmmm
2	Hour and minute	hhhhhhmmmmmmmm
3	Second and millisecond	sssssmmmmmmmmm

- The first **Word** contains an integer value referring to a year
- The second **Word** is divided into a high byte to represent a day and into a low byte to represent a month
- The third **Word** is divided into a high byte to represent hours and into a low byte to represent minutes
- The fourth **Word** uses the six highest bits to represent seconds and the 10 lowest bits to represent milliseconds

Acquisition Procedure

The PLC must start inserting events in ascending order, starting from table's base address, referring to the beginning of the circular buffer. At every new event inserted, the recording pointer must be incremented, starting to point to the next buffer's available address.


This Driver performs an event reading from the oldest one to the newest one. The starting address for reading is calculated by this Driver using the value of **Recording Pointer** and **Table Status**.

If the number of available events is greater than the maximum allowed in a single protocol's communication frame, this Driver performs multiple block readings, updating the value of **Acquisition Status** at the end of the process with the total amount of events read.

When detecting that this Driver wrote a value greater than 0 (zero) to **Acquisition Status**, the PLC must immediately subtract the value of **Acquisition Status** from the value of **Table Status** and then reset **Acquisition Status**.

The PLC can insert new events on the table during PLC's acquisition process, as long as there is no overflow in the circular buffer, then incrementing **Table Status**.

The next figure presents a flowchart, as a UML Activity Diagram, with a suggested implementation for this PLC logic.

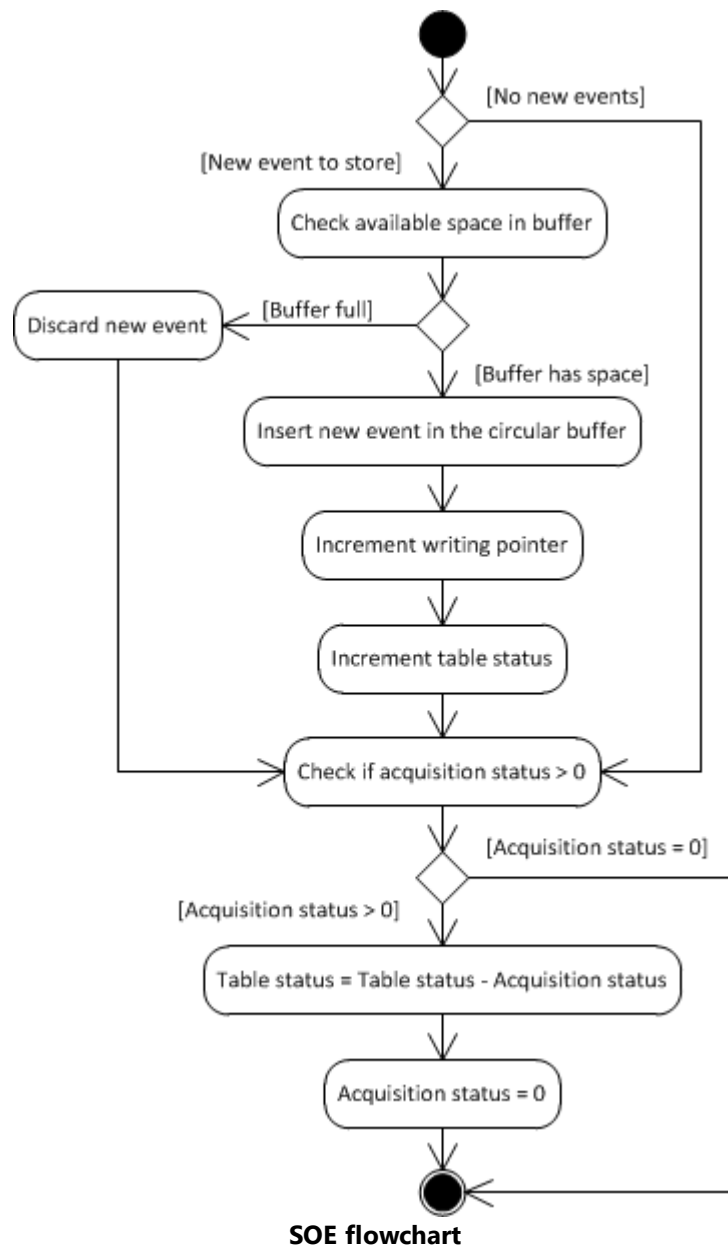

SOE flowchart

SOE Collecting Tags

The SOE collecting of events is performed by using the Tags described next, by using an ISOTCP communication with the PLC.

Block Tag for Control Register (Read-Only)

- **B1:** 0 (zero)
- **B2:** 391 (Data type = $3 \times 100 + \text{Data area} = 91$)
- **B3:** **DB** block number. If memory contains a single or unspecified **DB** block, fill it in with value 1 (one)
- **B4:** Not used

The Block Tag to query Control Registers must contain four Elements to return the following values:

- **Element 1:** Table status

- **Element 2:** Recording pointer
- **Element 3:** Acquisition status
- **Element 4:** Maximum limit of items on the circular buffer

For a description of each one of these Control Registers, please check topic **Preparing for SOE Collecting**.

Tag Block for Data Collecting (Read-Only)

- **B1:** 0 (zero)
- **B2:** Data type × 100 + Data area = 90
- **B3:** **DB** block number. If memory contains a single or unspecified **DB** block, fill it in with value 1 (one)
- **B4:** Not used

The Block Tag for Data Collecting must contain a number of Elements corresponding to the number of values of n -event type that compose a single event. If this event is composed of a single value, resize the Block Tag for Data Collecting with a single Element. If this event is composed by two values, the Block Tag must be resized to two Elements, and so on. Use Block Tag's $B2$ parameter to indicate a data type associated to event values.

NOTES

- All values that compose an event must have the same data type, as well as every PLC's **DB** table must be filled in with the same event type.
- Data Areas **90** and **91** exist only for use at the logical user application level. At the protocol level, both Tags work in PLC's Data Area **9 (DA_V)** automatically.

Documentation of I/O Interfaces

This section contains the documentation of I/O Interfaces referring to the **MProt** Driver.

Configuration of a Driver

I/O Interface configuration is performed on a Driver's configuration dialog box. To access the configuration of this dialog box in **Eclipse E3** in version 1.0, follow these steps:

1. Right-click a Driver object (IODriver).
2. Select the **Properties** item on the contextual menu.
3. Select the **Driver** tab.
4. Click **Other parameters**.

In **Eclipse E3** version 2.0 or later, click **Configure driver**  on a Driver's toolbar. In **Eclipse SCADA**, follow these steps:

1. Open the Organizer.
2. Select a Driver on Organizer's tree.
3. Click **Extras** on the **Driver** tab.

Currently, an I/O Interface allows opening only one connection for each Driver. This means that, if users want to access two serial ports, they must add two Drivers to an application and then configure each one of these Drivers for each serial port.

Configuration Dialog Box

The dialog box of I/O Interfaces allows configuring the I/O connection used by a Driver. This dialog box contains the **Setup**, **Serial**, **Ethernet**, **Modem**, and **RAS** tabs, described on the next topics. If a Driver does not implement a specific I/O connection, its corresponding tab is not available for configuration. Some Drivers may contain additional tabs, specific for that Driver, on the configuration dialog box.

Setup Tab

The **Setup** tab contains general configurations of a Driver. This tab is divided into the following groups:

- **General configurations:** Configurations of a Driver's physical layer, time-out, and initialization mode
- **Connection management:** Configurations on how the I/O Interface keeps a connection and which recovery policy is used on failure
- **Logging options:** Controls the generation of log files

The screenshot shows the 'Setup' tab of a configuration dialog box. It is organized into several sections:

- Physical Layer:** A dropdown menu is set to 'Ethernet'. To the right is an unchecked checkbox labeled 'Start driver OFFLINE'.
- Timeout:** A text input field contains '1000' followed by 'ms'.
- Communication check time:** A text input field contains '5000' followed by 'ms'.
- Connection management:** A sub-section containing:
 - A dropdown menu for 'Mode' set to 'Automatic (managed by the driver)'.
 - A checked checkbox for 'Retry failed connection every' followed by a text input '20' and 'seconds'.
 - An unchecked checkbox for 'Give up after' followed by a text input '1' and 'failed retries'.
 - An unchecked checkbox for 'Disconnect if non-responsive for' followed by a text input '0' and 'seconds'.
- Logging Options:** A sub-section containing:
 - An unchecked checkbox for 'Log to File:' followed by a text input field containing 'C:\eeLogs\MicrolokII_%DATE%.log'.
 - A text input field for 'File size limit (MB):' containing '0' with the note '('0' is unlimited)'.

Setup tab

General options on the Setup tab

OPTION	DESCRIPTION
Physical Layer	Select the physical layer on a list. Available options are Serial , Ethernet , Modem , and RAS . The selected interface must be configured on its specific tab
Timeout	Configure a time-out, in milliseconds, for the physical layer. This is the amount of time an I/O interface waits to receive any byte from the reception's buffer
Communication check time	Set the time, in milliseconds, to define the interval at which communication is considered to be in an inactive state. As long as an I/O Driver receives valid data, its communication state is considered active. However, if during operation an I/O Driver does not receive valid data inside this period of time, the state is considered inactive. The communication state is shown in the IO.CommunicationStatus Tag
Start driver OFFLINE	Select this option so that a Driver starts in Offline mode or stopped. This means that the I/O interface is not created until this Driver is configured to Online mode by using a Tag in an application. This mode enables a dynamic configuration of an I/O interface at run time

Options on the Connection management group

OPTION	DESCRIPTION
Mode	Selects a management mode of a connection. Selecting the Automatic option allows a Driver to manage the connection automatically, as specified in the next options. Selecting the Manual option allows an application to fully manage a connection
Retry failed connection every ... seconds	Select this option to enable a Driver's connection retry in a certain interval, in seconds. If the Give up after failed retries option is not selected, this Driver keeps retrying until a connection is performed, or until the application is stopped
Give up after ... failed retries	Enable this option to define a maximum number of connection retries. When the specified number of consecutive connection retries is reached, a Driver goes to the Offline mode, assuming that a hardware problem was detected. If a Driver establishes a successful connection, the number of unsuccessful retries is cleared. If this new connection is lost, then the retry counter starts at zero
Disconnect if non-responsive for ... seconds	Enable this option to force a Driver to disconnect if no byte was received by the I/O interface during the specified time-out, in seconds. This time-out must be greater than the time-out configured in the Timeout option

Options on the Logging Options group

OPTION	DESCRIPTION
<p>Log to File</p>	<p>Enable this option and configure the name of a file to write a log. Log files can be large, so use this option for short periods of time, only for testing and debugging purposes. If the %PROCESS% macro is used in the log file name, it is replaced by the identifier of the current process. This option is particularly useful when using several instances of the same Driver in Elipse E3, thus allowing each instance to generate a separate log file. For example, when configuring this option with value "c:\e3logs\drivers\sim_%PROCESS%.log", it generates a file named c:\e3logs\drivers\sim_00000FDA.log for process OFDAh. Users can also use the %DATE% macro in the file name. In this case a log file is generated every day, in the format aaaa_mm_dd. For example, when configuring this option with value "c:\e3logs\drivers\sim_%DATE%.log", it generates a file named c:\e3logs\drivers\sim_2005_12_31.log in 12/31/2005 and a file named c:\e3logs\drivers\sim_2006_01_01.log in 01/01/2006. Similarly, the %DATE_HOUR% macro generates one log file per hour, in the format aaaa_mm_dd_hh</p>
<p>File size limit (MB)</p>	<p>Configure the log file size limit, in megabytes. A value equal to 0 (zero) means that there is no size limit for the log file</p>

Serial Tab

Use this tab to configure parameters for a **Serial** Interface.

Serial

Port:

Baud rate:

Data bits:

Parity:

Stop bits:

Enable 'ECHO' suppression

Handshaking

DTR control:

RTS control:

Wait for CTS before send

CTS timeout: ms

Delay before send: ms

Delay after send: ms

Inter-byte delay (microseconds): μ s

Inter-frame delay (milliseconds): ms

Serial tab

General options on the Serial tab

OPTION	DESCRIPTION
Port	Select a serial port on the list, from COM1 to COM4 , or type the name of a serial port in the format COMn , such as "COM15". When typing the name of a serial port manually, the dialog box only accepts names of serial ports starting with the expression "COM"
Baud rate	Select a baud rate on the list (1200, 2400, 4800, 9600, 19200, 38400, 57600, or 115200) or type a baud rate, such as 600
Data bits	Select 7 (seven) or 8 (eight) data bits on the list
Parity	Select a parity on the list. The available options are None, Even, Odd, Mark, or List
Stop bits	Select the number of stop bits on the list. The available options are 1, 1.5, or 2 stop bits
Enable 'ECHO' suppression	Enable this option to remove the echo received after the I/O Interface sends data via serial port. If this echo is not equal to the bytes just sent, then the I/O Interface aborts communication
Inter-byte delay (microseconds)	Defines a delay between each byte transmitted by the I/O Interface, in millionths of a second, that is, 1000000 is equal to a second. This option must be used with small delays of less than a millisecond
Inter-frame delay (milliseconds)	Defines a delay between packets sent or received by the I/O Interface, in thousandths of a second, that is, 1000 is equal to a second. This delay is applied if the I/O Interface

OPTION	DESCRIPTION
	sends two consecutive packets, or between a received packet and the next sending

The **Handshaking** group configures the usage of **RTS**, **CTS**, and **DTR** signals in the handshaking process, that is, it controls when data can be sent or received via serial line. Most of the time, configuring the **DTR control** option to **ON** and the **RTS control** option to **Toggle** works with **RS232**-type serial lines as well as with **RS485**-type serial lines.

Available options on the Handshaking group

OPTION	DESCRIPTION
DTR control	Select the value ON to keep the DTR signal always on while the serial port is open. Select the value OFF to turn the DTR signal off while the serial port is open. Some devices require the DTR signal always on to allow communication
RTS control	Select the value ON to keep the RTS signal always on while the serial port is open. Select the value OFF to turn the RTS signal off while the serial port is open. Select the value Toggle to turn the RTS signal on while sending bytes via serial port and turn it off when not sending bytes, therefore enabling the reception
Wait for CTS before send	Available only when the RTS control option is configured with the value Toggle . Use this option to force a Driver to check the CTS signal before sending bytes via serial port, after turning the RTS signal on. In this mode, the CTS signal is handled as a permission flag for sending
CTS timeout	Determines a maximum time, in milliseconds, that a Driver waits for the CTS signal after turning the RTS signal on. If the CTS signal is not turned on within this time-out, that Driver then fails the current communication and returns an error
Delay before send	Some serial port devices have a delay when enabling a data sending circuit after the RTS signal is turned on. Configure this option to wait a certain number of milliseconds after turning the RTS signal on and before sending the first byte. IMPORTANT : This delay must be used carefully, because it uses 100% of CPU resources while waiting. System's general performance degrades as this value increases
Delay after send	This is the same effect of the Delay before send option, but in this case the delay is performed after sending the last byte, before turning the RTS signal off

Ethernet Tab

Use this tab to configure parameters of an **Ethernet** Interface. These parameters, except port configurations, must also be configured for use in the **RAS** Interface.

Ethernet

Transport: TCP/IP ▼

PING before connecting

Timeout: 4000 ms

Retries: 1

Listen for connections on port: 0

Share listen port with other processes

Interface: (All Interfaces) ▼

Use IPv6 Use SSL SSL Settings

Enable 'ECHO' suppression

IP Filter:

Connect to

<input type="checkbox"/> Main IP:	 	Port:	502	<input type="checkbox"/> Local port:	0
<input type="checkbox"/> Backup IP 1:	 	Port:	0	<input type="checkbox"/> Local port:	0
<input type="checkbox"/> Backup IP 2:	 	Port:	0	<input type="checkbox"/> Local port:	0
<input type="checkbox"/> Backup IP 3:	 	Port:	0	<input type="checkbox"/> Local port:	0

Ethernet tab

Available options on the Ethernet tab

OPTION	DESCRIPTION
Transport	Select the value TCP/IP for a TCP socket (<i>stream</i>) or select the value UDP/IP to use a UDP socket (<i>connectionless datagram</i>)
Listen for connections on port	Use this option to wait for new connections in a specific IP port, common in Slave Drivers. If this option remains unselected, a Driver connects to the address and port specified in the Connect to option
Share listen port with other processes	Select this option to share the listening port with other Drivers and processes
Interface	Select the local network interface, identified by its IP address, that a Driver uses to establish and receive connections, or select the value (All Interfaces) to allow connection in any network interface
Use IPv6	Select this option to force a Driver to use addresses in IPv6 format on all Ethernet connections. Leave this option deselected to use the IPv4 format
Enable 'ECHO' suppression	Enable this option to remove the echo from received data. An echo is a copy of sent data, which can be returned before a reply message
IP Filter	List of restricted or allowed IP addresses from where a Driver accepts connections (<i>Firewall</i>). Please check the IO.Ethernet.IPFilter property for more information
PING before connecting	Enable this option to execute a ping command, that is, to check whether a device can be reached on a network, for a device before trying a socket connection. This is a quick way

OPTION	DESCRIPTION
	<p>of determining a successful connection before trying to open a socket with a device. The time-out of a connection with a socket can be very high. The available options are:</p> <ul style="list-style-type: none"> • Timeout: Specify the number of milliseconds to wait for a reply from a ping command. Users must use a ping command to check the normal reply time, configuring this option for a value above that average. Usually this value can be configured between 1000 and 4000 milliseconds, that is, between 1 (one) and 4 (four) seconds • Retries: Number of retries of a ping command, not counting the first attempt. If all attempts fail, then the socket connection is aborted

Available options on the Connect to group

OPTION	DESCRIPTION
Main IP	Type the IP address of a remote device. Users can use an IP address separated by dots, as well as a URL. In case of a URL, a Driver uses the available DNS service to map that URL to an IP address, such as "192.168.0.13" or "Server1"
Port	Type the IP port of a remote device, between 0 (zero) and 65535
Local port	Select this option to use a fixed local IP port when connecting to a remote device
Backup IP 1, 2, and 3	Indicate the IP address, the IP port, and the fixed local IP port of up to 3 (three) backup addresses of a remote device

Modem Tab

Use this tab to configure parameters of a **Modem** Interface. Some options on the **Serial** tab affect the configuration of a modem, therefore users must also configure the **Serial** Interface.

Modem

Select the modem to use:

▼ Modem settings...

Dial Number:

Accept incoming calls

Modem tab

The **Modem** Interface uses the TAPI modems installed on the computer.

Available options on the Modem tab

OPTION	DESCRIPTION
Select the modem to use	Select a modem on the list of available modems on the computer. If the value Default modem is selected, then the first available modem is used. Selecting this option is recommended specially when an application is used on another computer
Modem settings	Click to open the configuration window of the selected modem
Dial Number	Type a default number for dialing. This value can be changed at run time. Users can use the w character to represent a pause or a waiting time for a dial tone. For example, "0w33313456" dials the number 0 (zero), waits, and then dials the number "33313456"
Accept incoming calls	Enable this option so that a Driver answers the phone when receiving an external call. To use this option, users must configure the Connection management option on the Setup tab to the value Manual

RAS Tab

Use this tab configure parameters of a **RAS** Interface. Users must also configure the **Ethernet** tab.


A **RAS** Interface opens a socket connection with a RAS device. A RAS device is a server of modems available through TCP/IP, waiting for socket connections on an IP port. For each connection accepted on this port, users have access to one modem.

When connecting to a RAS device, first the I/O Interface **IOKit** connects to the socket on the IP address and port configured on the **Ethernet** tab. After opening the socket, the following initialization or connection steps are performed:

1. Clears the socket, that is, removes any **TELNET** greeting message received from a RAS device.
2. Sends an **AT** dial message, in **ASCII** format, in the socket.
3. Waits for a **CONNECT** reply.
4. If the time-out expires, the connection is aborted.
5. If the **CONNECT** reply is received within the time-out, the socket is available for communication with a device, that is, the connection was established.

If step 5 (five) is successful, then the socket behaves as a normal socket, with the RAS device working as a router between a Driver and the device. Bytes sent by a Driver are received by the RAS device and sent to the destination device using a modem. Bytes received by the modem's RAS device are sent back to a Driver using the same socket.

After establishing a connection, the **RAS** interface monitors data received by a Driver. If a "NO CARRIER" **String** is found, the socket is closed. If the RAS device does not send a **NO CARRIER** signal, the **RAS** Interface cannot detect when the modem connection between the RAS device and the final I/O device fails. To recover from this failure, users are strongly advised to enable the **Disconnect if non-responsive** option on the **Setup** tab.

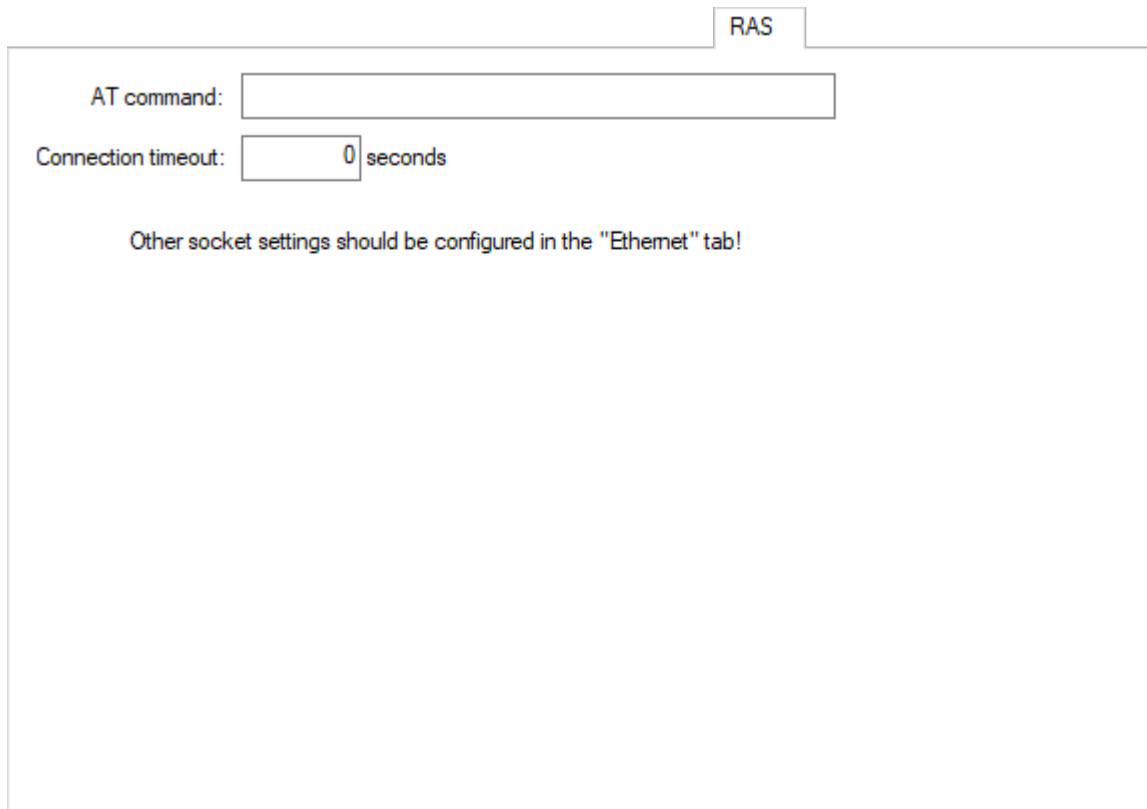

RAS tab

Available options on RAS tab

OPTION	DESCRIPTION
AT command	A String with the full AT command used to dial to a destination device. For example, "ATDT33313456" dials by tone to number "33313456"
Connection timeout	Number of seconds to wait for a modem's CONNECT reply, after sending an AT command

General Configurations

This section contains information about the configuration of general **I/O Tags** and **Properties** of I/O Interfaces.

I/O Tags

General I/O Interfaces Tags (N2/B2 = 0)

The Tags described next are provided for all supported I/O Interfaces.

IO.CommunicationStatus

Type of Tag	I/O Tag
Type of Access	Reading
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	6 (six)
String Configuration	IO.CommunicationStatus

This Tag informs the communication status of a Driver. It indicates how communication works relative to receiving valid data within a time period arbitrated in the configuration. For more information, please check topic **Setup Tab**. Possible values are **0 - Inactive communication**: The Driver did not receive valid data or stopped receiving data after *n* milliseconds, as configured in the properties window, or **1 - Active communication**: The Driver is receiving valid data.

IO.IOKitEvent

Type of Tag	Block Tag
Type of Access	Read-Only
B1 Parameter	-1 (minus one)
B2 Parameter	0 (zero)
B3 Parameter	0 (zero)
B4 Parameter	1 (one)
Size Property	4 (four)
ParamItem Property	IO.IOKitEvent

This Block returns Driver events generated by several sources in I/O Interfaces. The **TimeStamp** property of this Block represents the moment this event occurred. The Block Elements are the following:

- **Element 0**: Type of event. Possible values are **0**: Information, **1**: Warning, or **2**: Error
- **Element 1**: Source of an event. Possible values are **0**: Driver (specific of a Driver), **-1**: IOKit (generic events of I/O Interfaces), **-2**: **Serial** Interface, **-3**: **Modem** Interface, **-4**: **Ethernet** Interface, or **-5**: **RAS** Interface
- **Element 2**: Error number, specific for each source of event

- **Element 3:** Message of an event, a **String** specific for each event

NOTE

A Driver keeps a maximum number of 100 events internally. If additional events are reported, older events are discarded.

IO.PhysicalLayerStatus

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	2 (two)
String Configuration	IO.PhysicalLayerStatus

This Tag indicates the status of a physical layer. Possible values are the following:

- **0:** Physical layer stopped, that is, a Driver is in **Offline** mode, the physical layer failed when initializing, or exceeded the maximum number of reconnection attempts
- **1:** Physical layer started but not connected, that is, a Driver is in **Online** mode but the physical layer is not connected. If the **Connection management** option is configured with the value **Automatic**, the physical layer can be connecting, disconnecting, or waiting for a reconnection attempt. If the **Connection management** option is configured with the value **Manual**, then the physical layer remains in this status until forced to connect
- **2:** Physical layer connected, that is, the physical layer is ready for use. This **DOES NOT** mean a device is connected, only that the access layer is working

IO.SetConfigurationParameters

Type of Tag	Block Tag
Type of Access	Read-Only
B1 Parameter	-1 (minus one)
B2 Parameter	0 (zero)
B3 Parameter	0 (zero)
B4 Parameter	3 (three)
Size Property	2 (two)
ParamItem Property	IO.SetConfigurationParameters

Use this Tag to change any property of a Driver's configuration dialog box at run time.

This Tag works only while a Driver is in **Offline** mode. To start a Driver in **Offline** mode, select the **Start driver OFFLINE** option on that Driver's configuration dialog box. Users can write to a PLC Tag or to a Block Tag containing the parameters to change. Writing individual Block Elements is not supported, the whole Block must be written at once.

In **Elipse SCADA**, users must use a Block Tag. Every parameter to configure uses two Block Elements. For example, if users want to configure 3 (three) parameters, then the size of the Block must be 6 (six, 3×2). The first Element is the property's name, as a **String**, and the second Element is the property's value, according to the next example.

```
// 'Block' must be a Block Tag with automatic reading,
// scan reading, and automatic writings disabled.
// Configure all parameters
Block.element001 = "IO.Type" // Parameter 1
Block.element002 = "Serial"
Block.element003 = "IO.Serial.Port" // Parameter 2
Block.element004 = 1
Block.element005 = "IO.Serial.BaudRate" // Parameter 3
Block.element006 = 19200
// Writes the whole Block
Block.Write()
```

When using **Elipse E3**, the ability to create arrays at run time allows using an I/O Tag as well as a Block Tag. Users can use the **Write** method of a Driver to send the parameters directly to that Driver, without creating a Tag, according to the next example.

```
Dim arr(6)
' Configure all array elements
arr(1) = "IO.Type"
arr(2) = "Serial"
arr(3) = "IO.Serial.Port"
arr(4) = 1
arr(5) = "IO.Serial.BaudRate"
arr(6) = 19200
' There are two methods to send parameters
' Method 1: Using an I/O Tag
tag.WriteEx arr
' Method 2: Without using a Tag
Driver.Write -1, 0, 0, 3, arr
```

A variation of the previous example uses a bidimensional array.

```
Dim arr(10)
' Configure all array elements. Notice the array was resized
' to 10 elements. Empty array elements are ignored by a Driver
arr(1) = Array("IO.Type", "Serial")
arr(2) = Array("IO.Serial.Port", 1)
arr(3) = Array("IO.Serial.BaudRate", 19200)
Driver.Write -1, 0, 0, 3, arr
```

A Driver does not validate parameter names or passed values, therefore be careful when writing parameters and values. The **Write** method fails if the configuration array is incorrectly created. Users can check the log of a Driver or use the *writeStatus* parameter of the **WriteEx** method to find out the exact cause of an error.

```
Dim arr(10), strError
arr(1) = Array("IO.Type", "Serial")
arr(2) = Array("IO.Serial.Port", 1)
arr(3) = Array("IO.Serial.BaudRate", 19200)
If Not Driver.WriteEx -1, 0, 0, 3, arr, , strError Then
  MsgBox "Failed configuring Driver parameters: " + strError
End If
```

IO.WorkOnline

Type of Tag	I/O Tag
Type of Access	Reading or Writing
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	4 (four)
String Configuration	IO.WorkOnline

This Tag informs the current status of a Driver and allows starting or stopping the physical layer. Possible values are the following:

- **0 - Driver Offline:** Physical layer is closed or stopped. This mode allows a dynamic configuration of a Driver's parameters using the **IO.SetConfigurationParameters** Tag
- **1 - Driver Online:** Physical layer is open or executing. While in **Online** mode, the physical layer can be connected or disconnected and its current status can be checked using the **IO.PhysicalLayerStatus** Tag

In the next example, using **Eclipse E3**, a Driver is configured to **Offline** mode, its COM port is changed, and then configured to **Online** mode again.

```
'Configure to Offline mode
Driver.Write -1, 0, 0, 4, 0
'Change port to COM2
Driver.Write -1, 0, 0, 3, Array("IO.Serial.Port", 2)
'Configure to Online mode
Driver.Write -1, 0, 0, 4, 1
```

The **Write** method may fail when configuring a Driver to **Online** mode, that is, writing the value 1 (one). In this case, this Driver remains in **Offline** mode. The cause of failure can be:

- Type of physical layer incorrectly configured, probably an invalid value was configured in the **IO.Type** property
- This Driver may have run out of memory
- Physical layer probably did not create its working thread. Search the log file for a message "Failed to create physical layer thread!"
- Physical layer could not start. The cause of this failure depends on the type of physical layer. It can be an invalid serial port number, a failure when starting Windows Sockets, or a failure when starting TAPI (modem), among others. This cause is recorded on the log file

IMPORTANT

Even if the configuration of a Driver to **Online** mode is successful, this does not necessarily mean the physical layer is ready to use, that is, ready to execute input and output operations with an external device. The **IO.PhysicalLayerStatus** Tag must be checked to ensure the physical layer is connected and ready for communication.

Properties

These are general properties of all supported I/O Interfaces.

IO.ConnectionMode

9 Controls the management mode of a Connection. Possible values are **0**: Automatic mode, in which a Driver manages the connection or **1**: Manual mode, in which an application manages the connection.

IO.GiveUpEnable

☑ When configured to True, defines a maximum number of reconnection attempts. If all reconnection attempts fail, a Driver enters the **Offline** mode. When configured to False, a Driver tries until a reconnection is successful.

IO.GiveUpTries

9 Number of reconnection attempts before this one is aborted. For example, if the value of this property is equal to 1 (one), a Driver tries only one reconnection when the connection is lost. If this one fails, this Driver enters the **Offline** mode.

IO.InactivityEnable

☑ Configure to True to enable and to False to disable inactivity detection. The physical layer is disconnected if inactive for a certain period of time. The physical layer is considered inactive only if it is capable of sending data but not capable of receiving it back.

IO.InactivityPeriodSec

9 Number of seconds to check for inactivity. If the physical layer is inactive for this period of time, it is then disconnected.

IO.RecoverEnable

☑ Configure to True to enable a Driver to recover lost connections and to False to leave a Driver in **Offline** mode when a connection is lost.

IO.RecoverPeriodSec

9 Delay time between two connection attempts, in seconds.

NOTE

The first reconnection is executed immediately after a connection is lost.

IO.StartOffline

☑ Configure to True to start a Driver in **Offline** mode and to False to start a Driver in **Online** mode.


NOTE

It is pointless to change this property at run time, as it can only be changed when a Driver is already in **Offline** mode. To configure a Driver in **Online** mode at run time, write the value 1 (one) to the **IO.WorkOnline** Tag.

IO.TimeoutMs

9 Defines a time-out for the physical layer, in milliseconds. One second is equal to 1000 milliseconds.

IO.Type

 Defines the type of physical interface used by a Driver. Possible values are the following:

- **N or None:** Does not use a physical interface, that is, a Driver must provide a customized interface
- **S or Serial:** Uses a local serial port (COM n)
- **M or Modem:** Uses a local modem, internal or external, accessed via TAPI (*Telephony Application Programming Interface*)
- **E or Ethernet:** Uses a TCP/IP or UDP/IP socket
- **R or RAS:** Uses a **RAS** (*Remote Access Server*) Interface. A Driver connects to a RAS device using the **Ethernet** Interface and then sends an **AT** (*dial*) command

Statistical Configuration

This section contains information about the configuration of **I/O Tags** and **Properties** of I/O Interfaces statistics.

I/O Tags

Tags of I/O Interface Statistics (N2/B2 = 0)

The Tags described next display statistics for all I/O Interfaces.

IO.Stats.Partial.BytesRecv

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1101
Configuration by String	IO.Stats.Partial.BytesRecv

This Tag returns the number of bytes received in the current connection.

IO.Stats.Partial.BytesSent

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1100
Configuration by String	IO.Stats.Partial.BytesSent

This Tag returns the number of bytes sent through the current connection.

IO.Stats.Partial.TimeConnectedSeconds

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1102
Configuration by String	IO.Stats.Partial.TimeConnectedSeconds

This Tag returns the number of seconds a Driver is connected in the current connection or 0 (zero) if a Driver is disconnected.

IO.Stats.Partial.TimeDisconnectedSeconds

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1103
Configuration by String	IO.Stats.Partial.TimeDisconnectedSeconds

This Tag returns the number of seconds a Driver is disconnected since the last connection ended or 0 (zero) if a Driver is connected.

IO.Stats.Total.BytesRecv

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1001
Configuration by String	IO.Stats.Total.BytesRecv

This Tag returns the number of bytes received since a Driver was loaded.

IO.Stats.Total.BytesSent

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1000
Configuration by String	IO.Stats.Total.BytesSent

This Tag returns the number of bytes sent since a Driver was loaded.

IO.Stats.Total.ConnectionCount

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1004
Configuration by String	IO.Stats.Total.ConnectionCount

This Tag returns the number of connections a Driver already established, successfully, since it was loaded.

IO.Stats.Total.TimeConnectedSeconds

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1002
Configuration by String	IO.Stats.Total.TimeConnectedSeconds

This Tag returns the number of seconds a Driver remained connected since it was loaded.

IO.Stats.Total.TimeDisconnectedSeconds

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	0 (zero)
N4 Parameter	1003
Configuration by String	IO.Stats.Total.TimeDisconnectedSeconds

This Tag returns the number of seconds a Driver remained disconnected since it was loaded.

Properties

Currently, there are no properties defined specifically to display I/O Interface statistics at run time.

Ethernet Interface Configuration

This section contains information about the configuration of **I/O Tags** and **Properties** of an **Ethernet** Interface.

I/O Tags

Tags of an Ethernet Interface (N2/B2 = 4)

The Tags described next allow controlling and identifying an **Ethernet** Interface at run time and they are also valid when the **RAS** Interface is selected.

IMPORTANT

These Tags are available **ONLY** while a Driver is in **Online** mode.

IO.Ethernet.IPSelect

Type of Tag	I/O Tag
Type of Access	Reading or Writing
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	4 (four)
N4 Parameter	0 (zero)
String Configuration	IO.Ethernet.IPSelect

Indicates the active IP address. Possible values are **0**: The main IP address is selected, **1**: The first alternative or backup IP address is selected, **2**: The second alternative or backup IP address is selected, or **3**: The third alternative or backup IP address is selected.

If the **Ethernet** or **RAS** Interface is connected, this Tag indicates which one of the four configured IP addresses is in use. If the Interface is disconnected, this Tag indicates which IP address is used first on the next attempt to connect.

During the connection process, if the active IP address is not available, the I/O Interface tries to connect using the other IP address. If the connection with the alternative IP address works, it is configured as the active IP address (automatic switchover).

To force a manual switchover, write values from 0 (zero) to 3 (three) to this Tag. This forces a reconnection with the specified IP address (**0**: Main address or **1, 2, 3**: Alternative address) if a Driver is currently connected. If a Driver is disconnected, this Tag configures the active IP address for the next attempt to connect.

IO.Ethernet.IPSwitch

Type of Tag	I/O Tag
Type of Access	Write-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	4 (four)
N4 Parameter	1 (one)
String Configuration	IO.Ethernet.IPSwitch

Any value written to this Tag forces a manual switchover. If the main IP address is active, then the first alternative or backup IP address is activated, and so on for all alternative IP addresses and returning to the main address until a connection is established.

If a Driver is disconnected, this Tag configures the active IP address for the next attempt to connect.

IO.Ethernet.SocketState

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	4 (four)
N4 Parameter	2 (two)
String Configuration	IO.Ethernet.SocketState

The Value property of this Tag corresponds to socket states as a map of bits:

- **Bit 0**: 0 (zero, not listening) or 1 (one, listening)
- **Bit 1**: 0 (zero, disconnected) or 1 (one, connected)

Properties

These properties control the configuration of an **Ethernet** Interface.

NOTE

The **Ethernet** Interface is also used by the **RAS** Interface.

IO.Ethernet.AcceptConnection

☑ Configure to False if a Driver must not accept external connections, that is, if a Driver behaves as a master, or configure to True to enable the reception of connections, that is, if a Driver behaves as a slave.

IO.Ethernet.BackupEnable[2,3]

☑ Configure to True to enable an alternative or backup IP address. If the reconnection attempt with the main IP address fails, a Driver tries to use an alternative IP address. Configure to False to disable its usage.

IO.Ethernet.BackupIP[2,3]

📌 Alternative or backup IP address of a remote device. Users can use a numerical address, as well as a device's host name, such as "192.168.0.7" or "SERVER2".

IO.Ethernet.BackupLocalPort[2,3]

📌 Local port number to be used when connecting to an alternative IP address of a remote device. Used only if **IO.Ethernet.BackupLocalPortEnable** is equal to True.

IO.Ethernet.BackupLocalPortEnable[2,3]

☑ Configure to True to force the use of a specific local port when connecting to an alternative or backup IP address or configure to False to use any available local port.

IO.Ethernet.BackupPort[2,3]

📌 Port number of an alternative or backup IP address of a remote device, used with the **IO.Ethernet.BackupIP** property.

IO.Ethernet.IPFilter

📌 List with a comma-separated IPv4 or IPv6 addresses, which defines from which addresses a Driver accepts or blocks connections. Users can use asterisks, such as "192.168.*.*", or intervals, such as "192.168.0.41-50", in any part of IP addresses. To block an IP address or a range of IP addresses, use the tilde ("~") character at the beginning of the address, according to the next examples:

- **192.168.0.24**: Accepts only connections from IPv4 address 192.168.0.24
- **192.168.0.41-50**: Accepts connections from IPv4 addresses in the interval between 192.168.0.41 and 192.168.0.50
- **192.168.0.***: Accepts connections from IPv4 addresses in the interval between 192.168.0.0 and 192.168.0.255
- **fe80:3bf:877:::* (expands to fe80:03bf:0877:0000:0000:0000:0000:0000:*)**: Accepts connections from IPv6 addresses in the interval between fe80:03bf:0877:0000:0000:0000:0000:0000 and fe80:03bf:0877:0000:0000:0000:ffff:ffff
- **192.168.0.10, 192.168.0.15, 192.168.0.20**: Accepts connections from IPv4 addresses 192.168.0.10, 192.168.0.15, and 192.168.0.20
- **~192.168.0.95, 192.168.0.***: Accepts connections from IPv4 addresses in the interval between 192.168.0.0 and 192.168.0.255, except the IPv4 address 192.168.0.95

When a Driver receives a connection attempt, the list of filters is scanned sequentially from left to right, searching for a specific authorization or block for the IP address where the connection comes from. If no element on the list corresponds to the IP address, the authorization or block are dictated by the last element of that list:

- If the last element on the list is an authorization, such as "192.168.0.24", then all IP addresses not found on the list are blocked
- If the last element on the list is a block, such as "~192.168.0.24", then all IP addresses not found on the list are authorized

If an IP address appears on more than one filter on the list, the leftmost filter has precedence. For example, in case of "~192.168.0.95, 192.168.0.*", the IP address 192.168.0.95 fits both rules, but the rule that wins is the leftmost one, "~192.168.0.95", and therefore this IP address is blocked.

When **IOKit** blocks a connection, it logs a message "Blocked incoming socket connection from {IP}!".

In case of UDP connections in broadcast listening mode, in which a Driver can receive packets from different IP addresses, blocks or permissions are performed at each packet received. If a packet is received from a blocked IP address, it logs a message "Blocked incoming packet from {IP} (discarding {N} bytes)!".

IO.Ethernet.ListenIP

A IP address of the local network interface that a Driver uses to establish and accept connections. Leave this property empty to establish and accepts connections using any local network interface.

IO.Ethernet.ListenPort

9 Number of the IP port used by a Driver to listen to connections.

IO.Ethernet.MainIP

A IP address of a remote device. Users can use a numerical address, as well as a device's host name, such as "192.168.0.7" or "SERVER2".

IO.Ethernet.MainLocalPort

9 Local port number to use when connecting to the main IP address of a remote device. This value is only used if the **IO.Ethernet.MainLocalPortEnable** property is equal to True.

IO.Ethernet.MainLocalPortEnable

Configure to True to force the use of a specific local port when connecting to the main IP address of a remote device or configure to False to use any available local port.

IO.Ethernet.MainPort

9 Number of the IP port of a remote device, used with the **IO.Ethernet.MainIP** property.

IO.Ethernet.PingEnable

Configure to True to enable sending a **ping** command to the IP address of a remote device, before trying to connect to the socket. This socket's connection time-out cannot be controlled, therefore sending a **ping** command before connecting is a fast way to detect if the connection is going to fail. Configure to False to disable a **ping** command.

IO.Ethernet.PingTimeoutMs

9 Delay time to wait for a response from a **ping** command, in milliseconds.

IO.Ethernet.PingTries

9 Maximum number of attempts of a **ping** command. Minimum value is 1 (one), including the first **ping** command.

IO.Ethernet.ShareListenPort

☑ Configure to True to share a listening port with other Drivers and processes or False to open a listening port in exclusive mode. To successfully share a listening port, all Drivers and processes that use that port must open it in shared mode. When a listening port is shared, each incoming connection is distributed to one of the processes listening. This way, if a Slave Driver only supports one connection at a time, users can use several instances of this Driver listening on the same port, therefore simulating a Driver with support for multiple connections.

IO.Ethernet.SupressEcho

☑ Configure to True to eliminate echoes in communication. An echo is the unwanted reception of an exact copy of all data packets a Driver sent to a device.

IO.Ethernet.Transport

⚠ Defines a transport protocol. Possible values are **T or TCP**: Uses the TCP/IP protocol or **U or UDP**: Uses the UDP/IP protocol.

IO.Ethernet.UseIPv6

☑ Configure to True to use IPv6 addresses on all Ethernet connections or configure to False to use IPv4 addresses (default).

Modem Interface Configuration

This section contains information about the configuration of **I/O Tags** and **Properties** of a **Modem** (TAPI) Interface.

I/O Tags

Tags of a Modem Interface (N2/B2 = 3)

The Tags described next allow controlling and diagnosing a **Modem** (TAPI) Interface at run time.

IMPORTANT

These Tags are available **ONLY** while a Driver is in **Online** mode.

IO.TAPI.ConnectionBaudRate

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	5 (five)
String Configuration	IO.TAPI.ConnectionBaudRate

Indicates a baud rate value for the current connection. If a modem is not connected, returns the value 0 (zero).

IO.TAPI.Dial

Type of Tag	I/O Tag
Type of Access	Write-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	1 (one)
String Configuration	IO.TAPI.Dial

Write any value to this Tag to force a **Modem** Interface to start a call. This is an asynchronous command, only starting the call process. Users can monitor the **IO.TAPI.IsModemConnected** Tag to detect when a call is established.

IO.TAPI.HangUp

Type of Tag	I/O Tag
Type of Access	Write-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	4 (four)
String Configuration	IO.TAPI.HangUp

Any value written to this Tag hangs the current call up.

NOTE

Use this command only when managing the physical layer manually or when explicitly trying to force a Driver to restart the communication. If the physical layer is configured for automatic reconnection, a Driver immediately tries to reestablish the connection.

IO.TAPI.IsModemConnected

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	3 (three)
String Configuration	IO.TAPI.IsModemConnected

This Tag indicates the status of a modem connection. Possible values are **0**: The modem is not connected, but it may be performing or receiving an external call or **1**: The modem is connected and a Driver completed or received an external call successfully. While it is in this status, the physical layer can send or receive data.

IO.TAPI.IsModemConnecting

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	6 (six)
String Configuration	IO.TAPI.IsModemConnecting

This Tag indicates the status of a modem connection, with more details than the **IO.TAPI.IsModemConnected** Tag. Possible values are **0**: Modem is not connected, **1**: Modem is connecting, that is, performing or receiving an external call, **2**: Modem is connected. While in this status, the physical layer can send or receive data, or **3**: Modem is disconnecting the current call.

IO.TAPI.ModemStatus

Type of Tag	I/O Tag
Type of Access	Read-Only
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	2 (two)
String Configuration	IO.TAPI.ModemStatus

Returns a **String** with the current status of a modem. Possible values are the following:

- **"No status!"**: The **Modem** Interface was not open yet or was already closed
- **"Modem initialized OK!"**: The **Modem** Interface was initialized successfully
- **"Modem error at initialization!"**: A Driver could not initialize modem's line. Check that Driver's log file for more details
- **"Modem error at dial!"**: A Driver could not start or accept a call
- **"Connecting..."**: A Driver started a call successfully, and is currently processing that call
- **"Ringing..."**: Indicates that the modem is receiving an external call, but it did not accepted it yet
- **"Connected!"**: A Driver connected successfully, that is, completed or accepted an external call
- **"Disconnecting..."**: A Driver is turning the current call off
- **"Disconnected OK!"**: A Driver turned the current call off
- **"Error: no dial tone!"**: A Driver aborted a call because the available line signal was not detected
- **"Error: busy!"**: A Driver aborted a call because the line was busy
- **"Error: no answer!"**: A Driver aborted a call because no answer was received from the other modem
- **"Error: unknown!"**: Current call was aborted because of an unknown error

IO.TAPI.PhoneNumber

Type of Tag	I/O Tag
Type of Access	Reading or Writing
N1 Parameter	-1 (minus one)
N2 Parameter	0 (zero)
N3 Parameter	3 (three)
N4 Parameter	0 (zero)
String Configuration	IO.TAPI.PhoneNumber

This Tag is a **String** that reads or changes the telephone number used by the **IO.TAPI.Dial** Tag. When changing this Tag, the new value is used only on the next **Dial** command.

Properties

These properties control the configuration of a **Modem** (TAPI) Interface.

IO.TAPI.AcceptIncoming

9 Configure to False if a modem cannot accept external calls, that is, if a Driver behaves as a master, and configure to True to enable receiving calls, that is, if a Driver behaves as a slave.

IO.TAPI.ModemID

9 This is the identification number of a modem. This ID is created by Windows and used internally to identify a modem on a list of devices installed on a computer. This ID may not remain valid if a modem is reinstalled or an application is executed on another computer.

NOTE

It is advisable to configure this property as 0 (zero), indicating that a Driver must use the first available modem.

IO.TAPI.PhoneNumber

A A telephone number used by **Dial** commands, such as "0w01234566", in which the "w" character forces a modem to wait for a call sign.

RAS Interface Configuration

This section contains information about the configuration of **I/O Tags** and **Properties** of a **RAS** Interface.

I/O Tags

Tags of a RAS Interface (N2/B2 = 5)

Currently, there are no Tags defined specifically to manage a **RAS** Interface at run time.

Properties

These properties control the configuration of a **RAS** Interface.

NOTE

A **RAS** Interface uses the **Ethernet** Interface, which therefore must be also configured.

IO.RAS.ATCommand

A An **AT** command to send through a socket to force a RAS device to perform a call using the current RAS channel, such as "ATDT6265545".

IO.RAS.CommandTimeoutSec

9 Time to wait for a **CONNECT** message in response to an **AT** command, in seconds.

Serial Interface Configuration

This section contains information about the configuration of **I/O Tags** and **Properties** of a **Serial** Interface.

I/O Tags

Tags of a Serial Interface (N2/B2 = 2)

Currently, there are no Tags defined specifically to manage a **Serial** Interface at run time.

Properties

These properties control the configuration of a **Serial** Interface.

IO.Serial.Baudrate

9 Specifies a baud rate of a serial port, such as 9600.

IO.Serial.CTSTimeoutMs

9 Time to wait for a **CTS** signal, in milliseconds. After turning the **RTS** signal on, a timer is started to wait for a **CTS** signal. If this timer expires, a Driver aborts sending bytes through the serial port. Available only when the **IO.Serial.RTS** property is configured with the value **Toggle** and the **IO.Serial.WaitCTS** property is configured to True.

IO.Serial.DataBits

9 Specifies the number of data bits to configure a serial port. Possible values are **5**: Five data bits, **6**: Six data bits, **7**: Seven data bits, or **8**: Eight data bits.

IO.Serial.DelayAfterMs

9 Number of milliseconds to delay after the last byte is sent through a serial port, but before turning the **RTS** signal off. Available only when the **IO.Serial.RTS** property is configured with the value **Toggle** and the **IO.Serial.WaitCTS** property is configured to False.

IO.Serial.DelayBeforeMs

9 Number of milliseconds to delay after turning the **RTS** signal on, but before data is sent. Available only when the **IO.Serial.RTS** property is configured with the value **Toggle** and the **IO.Serial.WaitCTS** property is configured to False.

IO.Serial.DTR

A Indicates how a Driver deals with the **DTR** signal. Possible values are **OFF**: **DTR** signal is always turned off or **ON**: **DTR** signal is always turned on.

IO.Serial.InterbyteDelayUs

9 Delay time, in milliseconds (1/1000000 of a second), for each two bytes sent through a **Serial** Interface.

IO.Serial.InterframeDelayMs

9 Delay time, in milliseconds, before sending a packet after the last packet sent or received.

IO.Serial.Parity

A Specifies a parity for the configuration of a serial port. Possible values are **E or Even**: Even parity, **N or None**: No parity, **O or Odd**: Odd parity, **M or Mark**: Mark parity, or **S or Space**: Space parity.

IO.Serial.Port

9 Number of the local serial port. Possible values are **1**: Uses the COM1 port, **2**: Uses the COM2 port, **3**: Uses the COM3 port, or **n**: Uses the COMn port.

IO.Serial.RTS

A Indicates how a Driver deals with the **RTS** signal. Possible values are **OFF**: **RTS** signal always off, **ON**: **RTS** signal always on, or **Toggle**: Turns the **RTS** signal on when transmitting data and turns the **RTS** signal off when not transmitting data.

IO.Serial.StopBits

9 Specifies the number of stop bits for the configuration of a serial port. Possible values are **1**: One stop bit, **2**: One and a half stop bit, or **3**: Two stop bits.

IO.Serial.SuppressEcho

9 Use a value different from 0 (zero) to enable suppressing the echo or 0 (zero) to disable it.

IO.Serial.WaitCTS

▣ Configure to True to force a Driver to wait for the **CTS** signal before sending bytes when the **RTS** signal is turned on. Available only when the **IO.Serial.RTS** property is configured with the value **Toggle**.

Driver Revision History

VERSION	DATE	AUTHOR	COMMENTS
4.0.37	05/21/2025	M. Ludwig	<ul style="list-style-type: none"> Added support for importing Tags from TIA Portal version 20 (Case 37856).
4.0.35	04/14/2025	M. Ludwig	<ul style="list-style-type: none"> Documentation adjustment about reading or writing bits (Case 35721).
4.0.34	02/04/2025	M. Ludwig	<ul style="list-style-type: none"> The Device field is now automatically added to Tag Browser Tags (Case 37297).
4.0.33	12/11/2024	M. Ludwig	<ul style="list-style-type: none"> Driver updated to the most recent version of IOKit (Case 37033).
4.0.32	08/15/2024	A. Fetzner	<ul style="list-style-type: none"> Added support for importing Tags from TIA Portal version 19 (Case 35940).

VERSION	DATE	AUTHOR	COMMENTS
4.0.31	10/05/2023	M. Ludwig A. Fetzner	<ul style="list-style-type: none"> Fixed a miscalculation in the position of bits for data types with reversed bytes and inverted bits (<i>Case 34863</i>).
		A. Fetzner	<ul style="list-style-type: none"> Added support for UDTs (<i>User-Defined Types</i>) and Arrays with an initial limit different from 0 (zero) and modified the visualization of imported PLC Tags, by dividing them into folders for each table (<i>Case 34783</i>).
4.0.30	08/29/2023	A. Fetzner	<ul style="list-style-type: none"> Added support for importing Tags from TIA Portal versions 17 and 18 (<i>Case 31160</i>).
4.0.29	08/25/2023	M. Ludwig	<ul style="list-style-type: none"> Fixed a communication failure when this Driver is configured with the MPI protocol (<i>Case 32311</i>).
4.0.28	11/17/2021	M. Ludwig	<ul style="list-style-type: none"> Added an inter-frame delay option for the Ethernet layer (<i>Case 31757</i>).
4.0.27	08/02/2021	M. Ludwig	<ul style="list-style-type: none"> Implemented the WString data type (<i>Case 30670</i>).
4.0.26	05/05/2021	M. Ludwig	<ul style="list-style-type: none"> Implemented Int, Word, DInt, and DWord data types with the least significant byte first (<i>Case 30617</i>).
4.0.24	10/22/2020	M. Ludwig	<ul style="list-style-type: none"> Implemented a recursive list of DBs and TagTables within folders (<i>Case 29822</i>).
4.0.23	10/14/2020	M. Ludwig	<ul style="list-style-type: none"> Implemented an import process of Tags with an Array of complex structures data type (<i>Case 29560</i>).
4.0.22	09/24/2020	M. Ludwig	<ul style="list-style-type: none"> Fixed the duplication of imported Tags when opening the properties window and selecting the Import Tags tab for the first time (<i>Case 29560</i>).
4.0.21	09/18/2020	M. Ludwig	<ul style="list-style-type: none"> Created an MProt TIA Portal Importer (<i>Case 29179</i>). Implemented a process to import Tags (<i>Case 29185</i>).

VERSION	DATE	AUTHOR	COMMENTS
4.0.20	12/26/2019	M. Ludwig	<ul style="list-style-type: none"> Implemented a ReadOnce Tag (<i>Case 27374</i>). Implemented LSB First data types with reverse bits (<i>Case 27576</i>).
4.0.19	08/05/2019	M. Ludwig	<ul style="list-style-type: none"> Fixed a hold on the last value in cache (<i>Case 26110</i>). Driver ported to Visual Studio 2017 (<i>Case 27092</i>).
4.0.18	09/28/2018	M. Ludwig	<ul style="list-style-type: none"> Fixed a freeze on readings when using simultaneous connections after an unknown time (<i>Case 25235</i>).
4.0.17	02/08/2018	M. Ludwig	<ul style="list-style-type: none"> Implemented Int and DInt data types for syntactical parameters (<i>Case 23837</i>).
4.0.16	11/28/2017	M. Ludwig	<ul style="list-style-type: none"> Implemented rack, slot, and destination TSAP settings for backup addresses 2 and 3 (<i>Case 23428</i>).
4.0.13	09/11/2017	M. Ludwig	<ul style="list-style-type: none"> Fixed a freeze on readings when using simultaneous connections after an unknown time (<i>Case 23203</i>). Implemented a watchdog mechanism to trigger IP address switching (<i>Case 23270</i>).
4.0.12	07/06/2017	M. Ludwig	<ul style="list-style-type: none"> Fixed a problem when reading Strings in ISOTCP and ISOTCP243 protocols with extra connections (<i>Case 22950</i>).
4.0.11	06/20/2017	M. Ludwig	<ul style="list-style-type: none"> Disabled a grouped reading optimization when configured protocols ISOTCP and ISOTCP243 with optimization for Simultaneous Requests (<i>Case 22897</i>).
4.0.10	06/12/2017	C. Mello	<ul style="list-style-type: none"> Adjustments to isolate SOE Collecting from Superblock services and callback-oriented simultaneous connections (<i>Case 22785</i>).
4.0.9	05/29/2017	F. Englert	<ul style="list-style-type: none"> During a reconnection to a backup CPU, now there is an additional check on whether the destination TSAP address corresponds to the

VERSION	DATE	AUTHOR	COMMENTS
			new IP address. If it is not the expected IP address, this Driver does not send a connection request, and automatically recreates it considering the new IP address and its respective TSAP (<i>Case 22020</i>).
4.0.7	05/15/2017	M. Ludwig	<ul style="list-style-type: none"> Added TSAP destination settings in hexadecimal format (<i>Case 22432</i>).
4.0.4	04/10/2017	M. Ludwig	<ul style="list-style-type: none"> Implemented readings and writings of database gateway (<i>Case 22249</i>). Fixed a reading error of single BOOL and BYTE (<i>Case 22451</i>).
4.0.1	03/16/2017	M. Salvador M. Ludwig	<ul style="list-style-type: none"> Performance improvements on ISOTCP protocol (<i>Case 22246</i>).
3.1.2	05/12/2015	M. Ludwig	<ul style="list-style-type: none"> Fixed a denial in the option to select ISOTCP243 protocol (<i>Case 18675</i>).
3.1.1	09/19/2014	M. Ludwig	<ul style="list-style-type: none"> Implemented CPU redundancy, or automatic selection of backup CPU, alternative Rack or Slot, with connection to the backup IP address (<i>Case 15782</i>). Implemented the configuration of Rack, Slot, and connection type on Driver's properties window (<i>Case 15911</i>). Added Interface-specific Tags for the extra connections option (<i>Case 17221</i>).
3.0.1	12/20/2103	M. Salvador M. Ludwig	<ul style="list-style-type: none"> Implemented internal Superblocks in extra TCP connections (<i>Case 14025</i>). Driver ported to IOKit v2.00 (<i>Case 14019</i>).
2.13.1	08/21/2012	M. Ludwig	<ul style="list-style-type: none"> Implemented the PDU REF field functionality in ISOTCP protocol (<i>Case 13299</i>).
2.12.1	05/30/2012	C. Mello	<ul style="list-style-type: none"> Added support for SOE Collecting of events in DB tables (<i>Case 12483</i>).

VERSION	DATE	AUTHOR	COMMENTS
2.11.1	08/04/2011	M. Ludwig	<ul style="list-style-type: none"> • Included a consistency according to the MPI protocol and code improvements (<i>Case 12392</i>). • Added information about supporting Siemens S7-1200 series PLCs (<i>Case 12292</i>).
2.10.1	03/25/2011	M. Ludwig	<ul style="list-style-type: none"> • Implemented the S7 String format and a new properties window to configure Strings (<i>Case 12005</i>).
2.9.1	08/25/2009	M. Ludwig	<ul style="list-style-type: none"> • Fixed a problem when reading Counter-type variables (<i>Case 10701</i>). • Implemented advanced configurations for ISOTCP and ISOTCP243 protocols (<i>Case 10717</i>).
2.8.1	06/19/2009	M. Ludwig	<ul style="list-style-type: none"> • Fixed a problem in a disconnection addressing multiple slaves in MPI protocol (<i>Case 10595</i>).
2.7.1	06/03/2009	M. Ludwig	<ul style="list-style-type: none"> • Implemented the S5Time data type (<i>Case 10413</i>).
2.6.1	01/07/2009	M. Ludwig	<ul style="list-style-type: none"> • Fixed a connection failure under ISOTCP protocol (<i>Case 10138</i>).
2.5.1	11/04/2008	M. Ludwig	<ul style="list-style-type: none"> • Improvements on the layout of properties window (<i>Case 9994</i>). • Implemented an operation delay in PPI protocol (<i>Case 9968</i>).
2.4.1	04/01/2008	M. Ludwig	<ul style="list-style-type: none"> • Fixed a problem when addressing analog inputs and outputs combined with the EnableReadGrouping property configured to True (<i>Case 8927</i>). • Improvements and consistencies to avoid PLC's disconnection problems, as described on <i>Case 8968</i> (receiving random values in alarm variables in ISOTCP protocol). • Fixed an unhandled exception when receiving

VERSION	DATE	AUTHOR	COMMENTS
			<p>NAK characters in MPI protocol, which caused a lock on data reception (<i>Case 8981</i>).</p> <ul style="list-style-type: none"> • Improvements on consistency of MPI protocol reception (<i>Case 8981</i>). • Removed an unnecessary byte in the frame, which caused problems when writing bytes and bits under ISOTCP protocol and the S7-400 PLC (<i>Case 9021</i>). • Fixed a problem in the automatic reconnection after a physical disconnection in ISOTCP protocol (<i>Case 9030</i>). • Fixed the implementation of a long ACK frame reception in PPI protocol (<i>Case 9118</i>). • Implemented a condition of unavailable data in PPI protocol. When this condition is met, returns an empty list and OK instead of a failure (<i>Case 9232</i>). • Fixed a wrong attribution of Service Access Point in MPI protocol, which caused communication failures with Tecnatron adapters (<i>Case 9238</i>).
2.3.1	09/13/2007	M. Ludwig	<ul style="list-style-type: none"> • Fixed a reconnection problem with serial adapters when the PLC is turned off (<i>Case 8069</i>). • Implemented addressing to multiple slaves in MPI protocol (<i>Case 8625</i>). • Ethernet port freely configurable (<i>Case 8683</i>). • Driver compiled with IOKitLib v1.14 to fix reading and writing errors before the first connection (<i>Case 7614</i>). • Documentation updated with information about the length of Strings, protocols, and compatible devices (<i>Case 8206</i>).

VERSION	DATE	AUTHOR	COMMENTS
2.2.1	03/28/2007	M. Ludwig	<ul style="list-style-type: none"> • Fixed the lack of creating a blob, which caused errors at run time (<i>Case 8015</i>). • Fixed a problem when switching IP addresses at run time (<i>Case 8026</i>). • Added support for Windows CE (<i>Case 7504</i>). • Added support for IBHLink converters (<i>Case 7994</i>). • Fixed a writing problem with Strings (<i>Case 7967</i>).
2.1.1	07/10/2006	M. Ludwig	<ul style="list-style-type: none"> • Fixed the parsing of DB variables (<i>Case 7172</i>).
2.0.1	04/13/2006	M. Salvador M. Ludwig	<ul style="list-style-type: none"> • Fixed a failure in PPI protocol Error: Single DLE in data field (<i>Case 6644</i>). • Removed address check. Regardless of the data type, any value in <i>N4</i> is allowed (<i>Case 6644</i>). • Fixed a bug in the configuration interface, where IBHLink converter and ISOTCP protocol configurations were mixed. TCP/IP port 1099 was forced instead of TCP/IP port 102 (<i>Case 6644</i>). • Added support for Superblocks and symbolic addressing (<i>Case 6644</i>).
1.1.1	11/03/2005	M. Ludwig	<ul style="list-style-type: none"> • Optimization, standardization, and source code review.
1.0.1	05/01/2005	M. Salvador	<ul style="list-style-type: none"> • Original version of this Driver.

Headquarters

**Rua Mostardeiro, 322/Cj. 902, 1001 e
1002**

90510-002 — Porto Alegre — RS

Phone: (+55 51) 3346-4699

Fax: (+55 51) 3222-6226

E-mail: elipse-rs@elipse.com.br

Branch in Taiwan

9F., No.12, Beiping 2nd St., Sanmin Dist.

807 — Kaohsiung City — Taiwan

Phone: (+886 7) 323-8468

Fax: (+886 7) 323-9656

E-mail: evan@elipse.com.br

Check our website for information about a representative in your country.

www.elipse.com.br

kb.elipse.com.br

forum.elipse.com.br

www.youtube.com/elipsesoftware

elipse@elipse.com.br



Gartner, Cool Vendors in Brazil 2014, April 2014.

Gartner does not endorse any vendor, product or service depicted in its research publications, and does not advise technology users to select only those vendors with the highest ratings. Gartner research publications consist of the opinions of Gartner's research organization and should not be construed as statements of fact. Gartner disclaims all warranties, expressed or implied, with respect to this research, including any warranties of merchantability of fitness for a particular purpose.

Microsoft Partner
Gold Independent Software Vendor (ISV)